



EMC COMPLIANCE TEST REPORT

The Product

Equipment Under Test	: <u>POWER SUPPLY MODULE</u>
Model Number	: <u>MPA048-24</u>
Product Series	: <u>MPA024-24</u>
Trade Name	: <u>FATEK</u>
Report Number	: <u>HA229074-CE</u>
Issue Date	: <u>25-Oct-2022</u>

is produced by

FATEK AUTOMATION CORPORATION

26 F., No. 29, Sec. 2, Zhongzheng E. Rd., Tamsui Dist., New Taipei City 25170, TAIWAN (R.O.C.)



HongAn TECHNOLOGY CO., LTD.

HongAn TECHNOLOGY EMC Laboratory (Chung-Ho)

NO.15-1, CWEISHUH KENG, CWEIPIN VILLAGE, LINKOU DIST, NEW TAIPEI CITY, TAIWAN, R. O. C.

2F, NO.146, JIAN YI RD., CHUNG-HO DIST, NEW TAIPEI CITY, TAIWAN, R. O. C.

TEL: +886-2-22286610 **FAX:** +886-2-22286580 **E-mail:** hatlab@ms19.hinet.net

Caution :

The results in this report apply to the test sample(s) mentioned above at the time of the testing period only and are not to be used to indicate applicability to other similar products. This report does not imply that the production product(s) has met the criteria for certification. The report must not be used by the client to claim product certification, approval, or endorsement by TAF or any government agencies.

HongAn shall have no liability for any deductions, inferences or generalizations drawn by the client or others from the reports issued by us. Opinions or interpretations expressed in this report, if any, are outside the scope of HongAn accreditations. Any opinions expressed do not necessarily reflect the opinion of HongAn, unless otherwise stated.

The test report shall not be reproduced except in full, without written approval of HongAn.

Contents

1	General Description	11
1.1	Description of EUT	11
1.2	Test Facility	12
1.3	Test Instruments	12
1.4	Test Methodology	16
1.5	Auxiliary Equipments	16
1.6	Block Diagram	16
1.7	Identifying the Final Test Mode	16
1.8	Final Test Mode	16
1.9	Condition of Power Supply	16
1.10	EUT Configuration	17
1.11	Immunity Performance Classification	17
2	Conducted Emission Test (at Mains Port)	18
2.1	Test Instruments	18
2.2	Test Configuration and Procedure	18
2.3	Conducted Limit	19
2.4	Test Result	19
3	Radiated Emission Test	24
3.1	Test Instruments	24
3.2	Test Configuration and Procedure	24
3.3	Radiated Limit	25
3.4	Test Result	25
4	Harmonic Current Emission Measurement	30
4.1	Test Instruments	30
4.2	Test Configuration and Procedure	30
4.3	EUT Operation Condition	30
4.4	Test Limit	31
4.5	Test Result	31
5	Voltage Fluctuations and Flicker Measurement	34
5.1	Test Instruments	34
5.2	Test Configuration and Procedure	34
5.3	EUT Operation Condition	34
5.4	Test Limit	34
5.5	Test Result	34
6	Electrostatic Discharge Immunity Test	36

6.1	Test Instruments	36
6.2	Test Configuration and Procedure	36
6.3	Test Result	37
7	Radio-frequency, Electromagnetic Field Immunity Test	38
7.1	Test Instruments	38
7.2	Test Configuration and Procedure	38
7.3	Test Result	39
8	Electrical Fast Transient Test	41
8.1	Test Instrument	41
8.2	Test Configuration and Procedure	41
8.3	Test Result	42
9	Surge Immunity Test	43
9.1	Test Instrument	43
9.2	Test Configuration and Procedure	43
9.3	Test Result	44
10	Radio-frequency, Conducted Disturbances Immunity Test	45
10.1	Test Instruments	45
10.2	Test Configuration and Procedure	45
10.3	Test Result	46
11	Power Frequency Magnetic Field Immunity Test	47
11.1	Test Instruments	47
11.2	Test Configuration and Procedure	47
11.3	Test Result	48
12	Voltage Dips, Short Interruptions Immunity Test	49
12.1	Test Instrument	49
12.2	Test Configuration and Procedure	49
12.3	Test Result	50
13	Photographs of Test	51
13.1	Power Line Conducted Test (Model No.: MPA048-24)	51
13.2	Power Line Conducted Test (Series No.: MPA024-24)	52
13.3	Radiated Emission Test (Model No.: MPA048-24)	53
13.4	Radiated Emission Test (Series No.: MPA024-24)	54
13.5	Harmonic Current & Voltage Fluctuations and Flicker Measurement	55
13.6	Electrostatic Discharge Immunity Test	55
13.7	Radio-frequency, Electromagnetic Field Immunity Test	56
13.8	Electrical Fast Transient / Burst Immunity Test	56
13.9	Surge Immunity Test	57

13.10 Radio-frequency, Conducted Disturbances Immunity Test	57
13.11 Power Frequency Magnetic Field Immunity Test	58
13.12 Voltage Dips, Short Interruptions Immunity Test	58
14 Photographs of EUT	59
15 Photographs of Series	62
16 Photographs of ESD Test Points	65

Release control Record

Report Version	Description	Issued Date
V00	Original release.	25-Oct-2022

Verification

Applicant : FATEK AUTOMATION CORPORATION
Manufacturer : FATEK AUTOMATION CORPORATION
Equipment Under Test : POWER SUPPLY MODULE
Model Number : MPA048-24
Product Series : MPA024-24
Sample Received Date : 05-Oct-2022
Test Result : Complied
Test Standard :

Emission:	Immunity:
<input checked="" type="checkbox"/> EN IEC 61000-6-4:2019	<input checked="" type="checkbox"/> EN IEC 61000-6-2:2019
<input checked="" type="checkbox"/> IEC 61000-3-2:2019+A1:2021	<input checked="" type="checkbox"/> IEC 61000-4-2:2009
<input checked="" type="checkbox"/> EN 61000-3-3: 2013+A1:2019 +A2:2021	<input checked="" type="checkbox"/> IEC 61000-4-3:2020
	<input checked="" type="checkbox"/> IEC 61000-4-4:2012
	<input checked="" type="checkbox"/> IEC 61000-4-5: 2014+AMD1:2017
	<input checked="" type="checkbox"/> IEC 61000-4-6:2019
	<input checked="" type="checkbox"/> IEC 61000-4-8:2010
	<input checked="" type="checkbox"/> IEC 61000-4-11:2020

Remark:

This report details the results of the test carried out on one sample. This report shows the EUT is technically compliant with the EN IEC 61000-6-4 and EN IEC 61000-6-2 official requirements. This report applies to the above sample only and shall not be reproduced in part without written approval of HongAn Technology Co., Ltd.

Documented by: Jody Peng **Date:** 25-Oct-2022
Jody Peng

Tested by: Luke Lu **Date:** 14-Oct-2022
Luke Lu

Approved by: Eason Hsieh **Date:** 25-Oct-2022
Eason Hsieh

Summary of Test Result – Emission

Emission			
Test Standard	Test Item	Test Result	Remark
EN IEC 61000-6-4	Conducted Emission at AC mains port	Pass	Highest Emission (Model No.:MPA048-24) L: 0.173MHz, Q.P.55.92dBuV, Margin -23.08 dB A.V.52.97dBuV, Margin -13.03 dB N: 0.172MHz, Q.P.56.90dBuV, Margin -22.10 dB A.V.52.69dBuV, Margin -13.31 dB
			Highest Emission (Series No.:MPA024-24) L: 0.151MHz, Q.P.63.03dBuV, Margin -15.97 dB A.V.59.82dBuV, Margin -6.18 dB N: 0.150MHz, Q.P.65.23dBuV, Margin -13.77 dB A.V.61.91dBuV, Margin -4.09 dB
EN IEC 61000-6-4	Conducted Emission at telecommunications / network port	N/A	Without telecommunication port of the EUT.
EN IEC 61000-6-4	Radiated Emission	Pass	Highest Emission (Model No.:MPA048-24) H: 31.996MHz, 24.92dBuV, Margin-15.08 dB Antenna Height 375 cm, Turntable Angle 156° V: 36.995MHz, 26.86dBuV, Margin-13.14 dB Antenna Height 101 cm, Turntable Angle 172°
			Highest Emission (Series No.:MPA024-24) H: 35.317MHz, 24.95dBuV, Margin-15.05 dB Antenna Height 380 cm, Turntable Angle 98° V: 24.377MHz, 26.08dBuV, Margin-13.92 dB Antenna Height 115 cm, Turntable Angle 116°
EN IEC 61000-6-4	Radiated Emission (1 to 6 GHz)	N/A	The highest frequency of the internal sources of the EUT is less than 108 MHz, the measurement shall only be made up to 1GHz.
IEC 61000-3-2	Harmonic	Pass	Refer to Page 30
IEC 61000-3-3	Flicker	Pass	Refer to Page 34
<p>Remark:</p> <p>Since U_{Lab} of our lab is less than U_{CISPR}, no matter if determining compliance with the limits in this standard shall be based on the results of the compliance measurements taking into account the considerations on measurement instrumentation uncertainty or not, any adjustment of the test result is not necessary, which means,</p> <p style="text-align: center;">- compliance is deemed to occur if no measured disturbance level exceeds the disturbance limit;</p>			

- non-compliance is deemed to occur if measured disturbance level exceeds the disturbance limit.

N/A: Not Applicable.

Summary of Test Result – Immunity

Immunity				
Test Standard	Test Item	Performance Criteria	Observed Result Class	Test Result
IEC61000-4-2	Electrostatic Discharge	B	A	Pass
IEC61000-4-3	Radiated Susceptibility	A	A	Pass ¹
IEC61000-4-4	Electrical Fast Transient	B	A	Pass
IEC61000-4-5	Surge	B	A	Pass
IEC61000-4-6	Conducted Susceptibility	A	A	Pass
IEC61000-4-8	Magnetic Field	A	A	Pass
IEC61000-4-11	Voltage Dips and Interruption	Dip 0% B	A	Pass
		Dip 40% C	A	
		Dip 70% C	A	
		Interruptions 0% C	B	
<p>Remark : According to the test standard, the uncertainty related to EMS test instrument calibration and test levels need not be recorded in the test report and shall not be taken into account. N/A: Not Applicable. Note : 1. The test item was performed at an ISO 17025 accredited facility where this test item is covered under the scope of the facility's ISO 17025 accreditation. Detail of the facility is recorded at clause 1.2 of this report.</p>				

Measurement Uncertainty

Where relevant, the following measurement uncertainty levels has been estimated for tests performed on the EUT as specified in CISPR 16-4-2:

The listed uncertainties are the worst case uncertainty for the entire range of measurement. Please note that the uncertainty values are provided for informational purposes only and are not used in determining the PASS/FAIL results.

Test Item	Expanded Uncertainty (U_{lab})	Expanded Uncertainty (U_{cispr})
Conducted emission at AC mains power using a V-AMN, 9kHz – 150kHz	±2.75dB	±3.8dB
Conducted emission at AC mains power using a V-AMN, 150kHz – 30MHz	±2.92dB	±3.4dB
Conducted emission at telecommunication port using AAN, 150kHz – 30MHz	±4.63dB	±5.0dB
Radiated emission, 30MHz – 1GHz (Horizontal)	±4.92dB	±6.3dB
Radiated emission, 30MHz – 1GHz (Vertical)	±5.05dB	±6.3dB
Radiated emission, 1GHz – 6GHz	±4.35dB	±5.2dB
Radiated emission, 6GHz – 18GHz	±4.77dB	±5.5dB
Radiated electromagnetic disturbances using a LLAS, 9kHz – 30MHz	±3.27dB	±3.3dB
Disturbance Power, 30MHz – 300MHz	±4.04dB	±4.5dB

This reported expanded uncertainty is based on a standard uncertainty multiplied by a coverage factor of $k = 2$, providing a level of confidence of approximately 95%.

1 General Description

1.1 Description of EUT

Equipment Under Test	: POWER SUPPLY MODULE
Model Number	: MPA048-24
Product Series	: MPA024-24
Applicant	: FATEK AUTOMATION CORPORATION
Address of Applicant	: 26 F., No. 29, Sec. 2, Zhongzheng E. Rd., Tamsui Dist., New Taipei City 25170, TAIWAN (R.O.C.)
Manufacturer	: FATEK AUTOMATION CORPORATION
Address of Manufacturer	: 26 F., No. 29, Sec. 2, Zhongzheng E. Rd., Tamsui Dist., New Taipei City 25170, TAIWAN (R.O.C.)
Power Supply	: Input: 100~240Vac, 1A, 50/60Hz Output: 24Vdc, 2A, Max. 48
I/O Port	: AC IN*3,DC OUT*2
Data Cable	: N/A
Description of EUT	<p>Dimensions : 90 mm X 33.7 mm X 90 mm</p> <p>Position : <input checked="" type="checkbox"/>Table-top / <input type="checkbox"/>Floor-standing</p> <p>Highest Frequency of the Internal Source : 100kHz</p> <p>Intended Function : The EUT is a POWER SUPPLY MODULE.</p> <p>Product Variance : The manufacturer declares that the series products share the identical circuit design with the main test sample. The differences between them are the transformer they applied respectively. By applying different transformer the output power of MPA048-24 is 48 watt and the output power of MPA024-24 is 24 watt. Radiated Emission and Conducted Emission of both models have been evaluated and reported.</p>

1.2 Test Facility

Linkou Facility:	Address : No. 15-1, Cweishuh Keng, Cweipin Village, Linkou, New Taipei City, Taiwan, R.O.C.	
EMI	<input type="checkbox"/> HA1	<input type="checkbox"/> RE 10m OATS/ <input type="checkbox"/> CE
	<input checked="" type="checkbox"/> HA2	<input type="checkbox"/> RE 3m OATS/ <input checked="" type="checkbox"/> RE 10m OATS/ <input type="checkbox"/> RE 3m FSOATS/ <input type="checkbox"/> CE
	<input checked="" type="checkbox"/> HA3	<input checked="" type="checkbox"/> Harmonic/ <input checked="" type="checkbox"/> Flicker
EMS	<input checked="" type="checkbox"/> HA3	<input type="checkbox"/> ESD/ <input checked="" type="checkbox"/> RS/ <input type="checkbox"/> EFT/ <input type="checkbox"/> Surge/ <input type="checkbox"/> CS/ <input checked="" type="checkbox"/> MF/ <input type="checkbox"/> Dip
Chung-Ho Facility	Address: 2F, No.146, Jian Yi Rd., Chung-Ho Dist, New Taipei City, Taiwan, R.O.C.	
EMI	<input checked="" type="checkbox"/> HA5	<input checked="" type="checkbox"/> CE
EMS	<input checked="" type="checkbox"/> HA6	<input checked="" type="checkbox"/> ESD/ <input checked="" type="checkbox"/> EFT/ <input checked="" type="checkbox"/> Surge/ <input checked="" type="checkbox"/> CS/ <input checked="" type="checkbox"/> Dip

Radiated Susceptibility(level 10V/m and above 3GHz) and Magnetic Field(level 30A/m) Tests are performed at Taiwan Testing and Certification Center, Linkou Testing Lab, TAF Registration No:2628, Location: No.34, Lin 5. DingFu, Linkou Dist., New Taipei City, Taiwan, R. O. C.

1.3 Test Instruments

Conducted Emission					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
EMI Test Receiver	R&S	ESCI	100615	21-Jul-2022	20-Jul-2023
LISN	EMCIS	LN2-16	LN04023	28-Jun-2022	27-Jun-2023
LISN	SCHWARZBEC K	NSLK 8127	01019	26-Jul-2022	25-Jul-2023
LISN+Adapter	SCHWARZBEC K	NSLK 8127	01019	26-Jul-2022	25-Jul-2023
ISN	TESEQ	ISN T800	30838	26-Jul-2022	25-Jul-2023
Cable	HARBOUR	RG 400	1.5m	07-Jul-2022	06-Jul-2023
Software	Audix	e3 (ver 6.101006e)	N/A	N/A	N/A
Software	R&S	Click Rate Analyzer(V2.5.2)	N/A	N/A	N/A
Radiated Emission Test					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
EMI Test Receiver	R&S	ESC17	100931	28-Jul-2022	27-Jul-2023
Spectrum Analyzer	R&S	FSV 40	101296	06-Apr-2022	05-Apr-2023
Preamplifier	SCHAFFNER	CPA 9231A	0405	17-Dec-2021	16-Dec-2022
Preamplifier (1-18GHz)	EMCI	EMC051845SE	980692	06-Dec-2021	05-Dec-2022

Preamplifier (18~40GHz)	EMCI	EMC184045SE	980699	12-May-2022	11-May-2023
Loop Antenna	EMCO	6502	9202-2717	31-Aug-2022	30-Aug-2023
Bilog Antenna(3m)	TESEQ	CBL6111D	47016	22-Jul-2022	21-Jul-2023
Bilog Antenna(10m)	TESEQ	CBL6111D	47016	22-Jul-2022	21-Jul-2023
Horn Antenna	EMCO	3115	9912-5992	24-Feb-2022	23-Feb-2023
Horn Antenna	Com-Power	AH-840	101042	14-May-2022	13-May-2023
Cable	HongAn	8D-FB	HA2-10MSite	19-Aug-2022	18-Aug-2023
RF Cable (1~18GHz)	EMCI	EMC104-SM-N M-1000	191104	05-Dec-2021	04-Dec-2022
RF Cable (1~18GHz)	EMCI	EMC104-SM-N M-8000	191103	09-Dec-2021	08-Dec-2022
RF Cable (18~40GHz)	EMCI	EMC102-KM-K M-1000	200301	12-May-2022	11-May-2023
RF Cable (18~40GHz)	WisPEC	291LKA2292-8000	WSP-C-202205-001	02-Jun-2022	01-Jun-2023
Signal Generator	R&S	SMB100A	110549	23-Aug-2022	22-Aug-2023
Software	Audix	e3 (ver 6.101006a)	N/A	N/A	N/A
Harmonic Current Emission					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
Signal conditioning unit	TESEQ	CCN 1000-1	1918A03073	30-Jun-2022	29-Jun-2023
AC Power Source	TESEQ	NSG 1007	1919A00280	30-Jun-2022	29-Jun-2023
Software	TESEQ	CTS4 (Version 4.29.0)	N/A	N/A	N/A
Voltage Fluctuations and Flicker					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
Signal conditioning unit	TESEQ	CCN 1000-1	1918A03073	30-Jun-2022	29-Jun-2023
AC Power Source	TESEQ	NSG 1007	1919A00280	30-Jun-2022	29-Jun-2023
Software	TESEQ	CTS4 (Version 4.29.0)	N/A	N/A	N/A
Electrostatic Discharge immunity test					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
ESD Simulator	NoiseKen	TC-815R	ESS0868491	28-Mar-2022	27-Mar-2023
ESD Simulator	NoiseKen	ESS-2002	ESS0868406	28-Mar-2022	27-Mar-2023
Radiated, radio-frequency, electromagnetic field immunity test					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date

Signal Generator	R&S	SMB100A	110549	23-Aug-2022	22-Aug-2023
RF Power Amplifier	ar	150W1000	0343919	N/A	N/A
RF Amplifier	ar	15S1G3	306578	N/A	N/A
Dual Directional Coupler	WERLATONE	C6021-10	108038	N/A	N/A
Directional Coupler	ATM	CHPsc22L-40	Q308504-01	N/A	N/A
Power Sensor	TESEQ	PM6003	074395	21-Jul-2022	20-Jul-2023
Power Sensor	TESEQ	PM6003	074396	21-Jul-2022	20-Jul-2023
Bilog Antenna	TESEQ	CBL6111D	58161	12-Jan-2022	11-Jan-2023
Horn Antenna	EMCO	3115	9912-5992	24-Feb-2022	23-Feb-2023
Broadband Field Meter	Narda	NBM-520	D-0519	16-Oct-2021	15-Oct-2022
Probe	Narda	EF-0691	D-0102	16-Oct-2021	15-Oct-2022
Software	Audix	i2 (ver 20151112c)	N/A	N/A	N/A
Electrical fast transient/burst immunity test					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
TRANSIENT 2000	EMC PARTNER	TRA2000	449	19-Jul-2022	18-Jul-2023
Software	EMC PARTNER	Ver 3.240	N/A	N/A	N/A
Surge immunity test					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
TRANSIENT 2000	EMC PARTNER	TRA2000	449	19-Jul-2022	18-Jul-2023
Software	EMC PARTNER	Ver 3.240	N/A	N/A	N/A
Immunity to conducted disturbances, induced by radio-frequency fields					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
CONDUCTED IMMUNITY TEST SYSTEM	FRANKONIA	CIT-10/75	102C3208	27-Feb-2022	26-Feb-2023
Power Attenuator	FRANKONIA	75-A-FFN-06	0212	27-Feb-2022	26-Feb-2023
CDN	FRANKONIA	CDN M2+M3	A3011037	09-Mar-2022	08-Mar-2023
Software	FRANKONIA	IEC 61000-4-6/ Ver 2.22	N/A	N/A	N/A
Power frequency magnetic field immunity test					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
EMCPro Plus EMC Test System	ThermoFisher	EMC Pro PLUS	1507189	18-May-2022	17-May-2023
Magnetic Field	ThermoFisher	F-1000-4-8/9/10	9953	18-May-2022	17-May-2023

Immunity Loop		-L-1M			
Software	KeyTek	CEWare32 (ver 4.1)	N/A	N/A	N/A
Voltage dips, short interruptions and voltage variations immunity tests					
Instrument Name	Manufacture	Model Number	Serial Number	Last Cal. Date	Next Cal. Date
TRANSIENT 2000	EMC PARTNER	TRA2000	449	19-Jul-2022	18-Jul-2023
Software	EMC PARTNER	Ver 3.240	N/A	N/A	N/A

※ The test equipments used are calibrated and can be traced to National ITRI and International Standards.

1.4 Test Methodology


All Emission Tests were performed according to the procedures specified in EN IEC 61000-6-4.
 All Immunity Tests were performed according to the procedures specified in EN IEC 61000-6-2.
 Deviations from the test standards as below description :N/A

1.5 Auxiliary Equipments

1.5.1 Provided by HongAn Technology Co., Ltd..

No.	Equipment	Model No.	Serial No.	EMC Approved	Brand	Description	
						Data Cable	Power Cable
1	Load*2	(12Ω/24Ω)	N/A	N/A	N/A	N/A	N/A
2	AC Power Cable*2	N/A	N/A	N/A	N/A	N/A	Non-shielded , Detachable 1.2m ,w/o core

1.6 Block Diagram

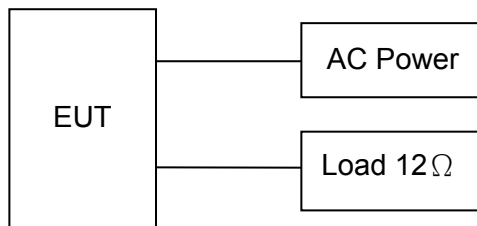

1.7 Identifying the Final Test Mode

1. Mode 1: Operation Mode (48W)
2. Mode 2: Operation Mode (24W)

Note: After pre-test, we identified that the Operation Mode (the worst case) was most likely to cause maximum disturbance and most likely to be susceptible to disturbance. Therefore, the final EMC assessment was performed for the worst case.

1.8 Final Test Mode

Mode 1: Operation Mode (48W) by client’s decision.

1.9 Condition of Power Supply

AC 230V; 50Hz

1.10 EUT Configuration

1. Setup the EUT as shown in Sec.1.6 Block Diagram.
2. Turn on the power of all equipments.
3. Activate the selected Final Test Mode shown in Sec. 1.8.

1.11 Immunity Performance Classification

Criterion	Test Description
A	The apparatus shall continue to operate as intended during and after the test. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer, when the apparatus is used as intended. The performance level may be replaced by a permissible loss of performance. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, either of these may be derived from the product description and documentation and what the user may reasonably expect from the apparatus if used as intended.
B	The apparatus shall continue to operate as intended after the test. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer, when the apparatus is used as intended. The performance level may be replaced by a permissible loss of performance. During the test, degradation of performance is however allowed. No change of actual operating state or stored data is allowed. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, either of these may be derived from the product description and documentation and what the user may reasonably expect from the apparatus if used as intended.
C	Temporary loss of function is allowed, provided the function is self-recoverable or can be restored by the operation of the controls.

2 Conducted Emission Test (at Mains Port)

2.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

2.2 Test Configuration and Procedure

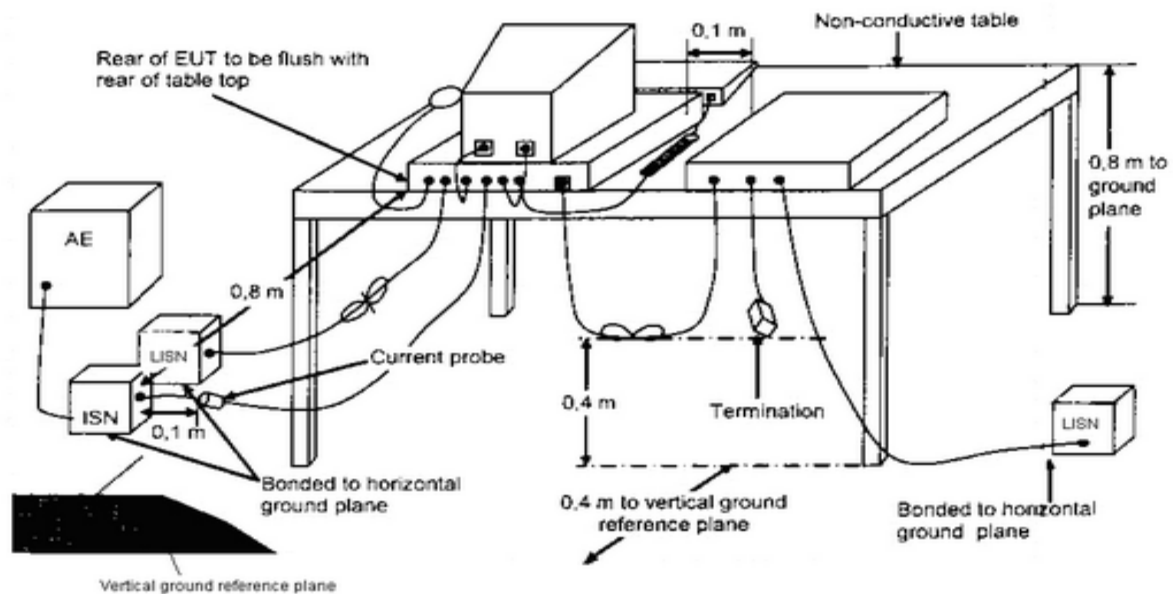


Table-top Equipment

- The EUT was placed on a non-conductive table which was 80 cm above the horizontal coupling plane. The rear of the EUT was 40 cm from the vertical coupling plane.
- The excess interface cables were folded at the cable center into a bundle no longer than 40 cm, so that the bundles were on the table.
- The EUT was connected to the main power through a L.I.S.N. This set up provided 50 ohm / 50 μ H coupling impedance for the measuring equipment.
- All auxiliary equipment received power from a second L.I.S.N.
- The conducted emissions were measured between the Line Phase and the PE ground and between the Neutral Phase and the PE ground using an EMI Receiver.
- The values were recorded.

2.3 Conducted Limit

EN IEC 61000-6-4

Low Voltage AC Mains Port		
Frequency (MHz)	Quasi-Peak dB(μ V)	Average dB(μ V)
0.15 to 0.50	79	66
0.5 to 30	73	60


2.4 Test Result

PASS

The final test data are shown on the following page(s).

Conducted Emission Test Data

Test Site : HA5 Test Date : 14-Oct-2022
 Model Number : MPA048-24 Temperature : 25°C
 Power Phase : LINE Humidity : 51%RH
 Test voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 1

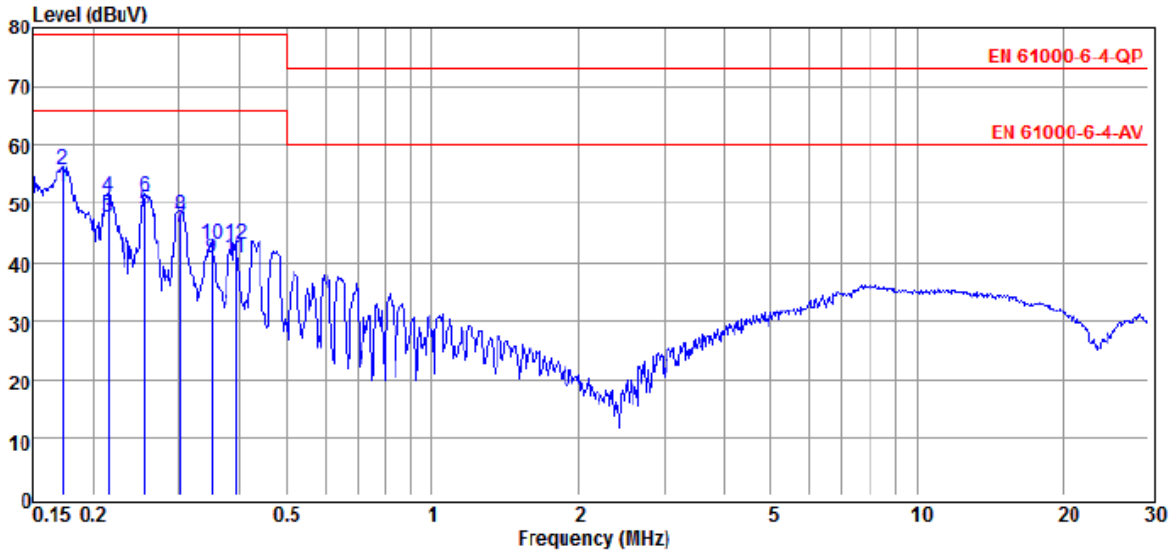


No.	Freq MHz	Reading dBuV	C.F dB	Result dBuV	Limit dBuV	Margin dB	Power Line	Remark
1	0.173	52.87	0.10	52.97	66.00	-13.03	LINE	Average
2	0.173	55.82	0.10	55.92	79.00	-23.08	LINE	QP
3	0.215	47.40	0.10	47.50	66.00	-18.50	LINE	Average
4	0.215	51.06	0.10	51.16	79.00	-27.84	LINE	QP
5	0.255	48.90	0.10	49.00	66.00	-17.00	LINE	Average
6	0.255	51.22	0.10	51.32	79.00	-27.68	LINE	QP
7	0.302	45.84	0.11	45.95	66.00	-20.05	LINE	Average
8	0.302	48.17	0.11	48.28	79.00	-30.72	LINE	QP
9	0.350	40.65	0.11	40.76	66.00	-25.24	LINE	Average
10	0.350	43.01	0.11	43.12	79.00	-35.88	LINE	QP
11	0.393	40.54	0.11	40.65	66.00	-25.35	LINE	Average
12	0.393	42.96	0.11	43.07	79.00	-35.93	LINE	QP

- Remark : 1. All readings are Quasi-Peak and Average values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

Conducted Emission Test Data

Test Site : HA5 Test Date : 14-Oct-2022
 Model Number : MPA048-24 Temperature : 25°C
 Power Phase : NEUTRAL Humidity : 51%RH
 Test voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 1

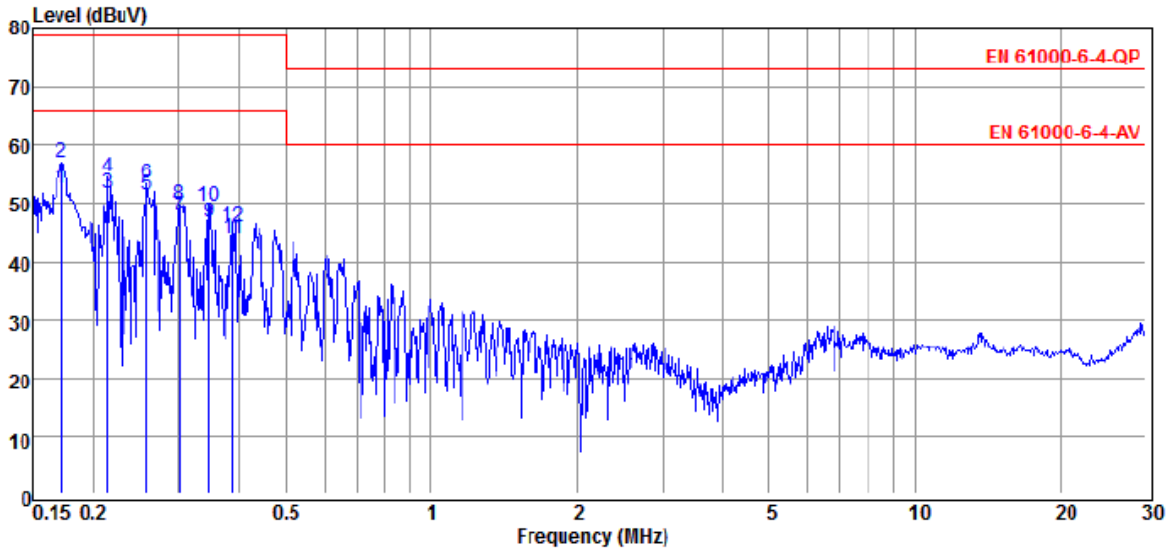


No.	Freq MHz	Reading dBµV	C.F dB	Result dBµV	Limit dBµV	Margin dB	Power Line	Remark
1	0.172	52.61	0.08	52.69	66.00	-13.31	NEUTRAL	Average
2	0.172	56.82	0.08	56.90	79.00	-22.10	NEUTRAL	QP
3	0.214	51.59	0.07	51.66	66.00	-14.34	NEUTRAL	Average
4	0.214	54.34	0.07	54.41	79.00	-24.59	NEUTRAL	QP
5	0.258	51.28	0.08	51.36	66.00	-14.64	NEUTRAL	Average
6	0.258	53.38	0.08	53.46	79.00	-25.54	NEUTRAL	QP
7	0.300	47.68	0.08	47.76	66.00	-18.24	NEUTRAL	Average
8	0.300	49.65	0.08	49.73	79.00	-29.27	NEUTRAL	QP
9	0.346	46.68	0.08	46.76	66.00	-19.24	NEUTRAL	Average
10	0.346	49.38	0.08	49.46	79.00	-29.54	NEUTRAL	QP
11	0.389	43.95	0.08	44.03	66.00	-21.97	NEUTRAL	Average
12	0.389	45.78	0.08	45.86	79.00	-33.14	NEUTRAL	QP

- Remark : 1. All readings are Quasi-Peak and Average values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

Conducted Emission Test Data

Test Site : HA5
 Series Number : MPA024-24
 Power Phase : LINE
 Test voltage : 230V/50Hz
 Description : Mode 2
 Test Date : 14-Oct-2022
 Temperature : 25°C
 Humidity : 51%RH
 Test by : Luke Lu

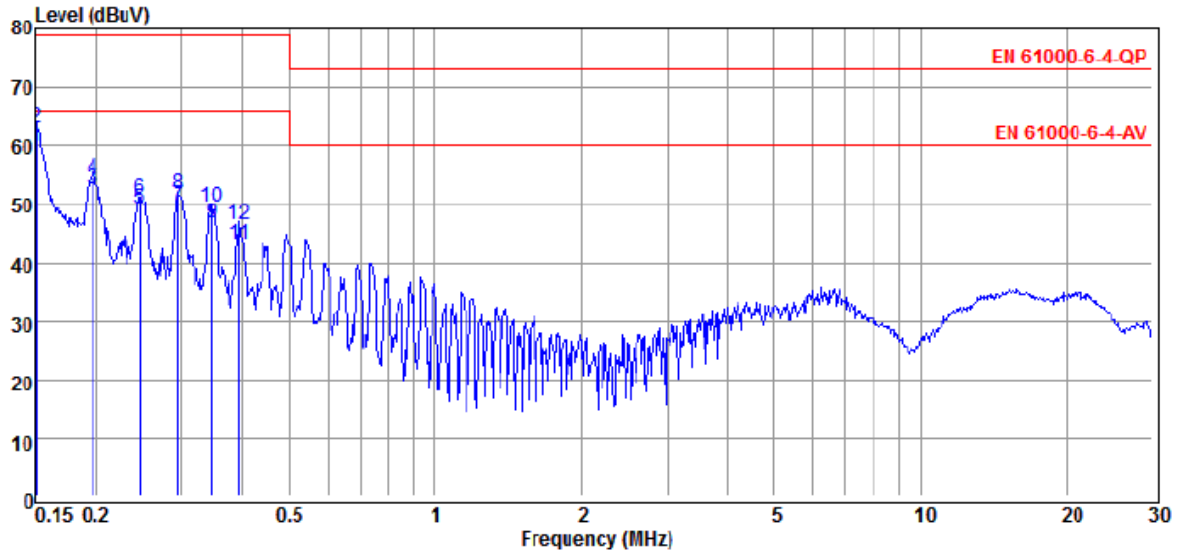


No.	Freq MHz	Reading dBµV	C.F dB	Result dBµV	Limit dBµV	Margin dB	Power Line	Remark
1	0.151	59.72	0.10	59.82	66.00	-6.18	LINE	Average
2	0.151	62.93	0.10	63.03	79.00	-15.97	LINE	QP
3	0.197	52.54	0.10	52.64	66.00	-13.36	LINE	Average
4	0.197	54.43	0.10	54.53	79.00	-24.47	LINE	QP
5	0.247	49.07	0.09	49.16	66.00	-16.84	LINE	Average
6	0.247	50.97	0.09	51.06	79.00	-27.94	LINE	QP
7	0.296	49.76	0.11	49.87	66.00	-16.13	LINE	Average
8	0.296	51.74	0.11	51.85	79.00	-27.15	LINE	QP
9	0.346	46.69	0.11	46.80	66.00	-19.20	LINE	Average
10	0.346	49.47	0.11	49.58	79.00	-29.42	LINE	QP
11	0.396	42.96	0.11	43.07	66.00	-22.93	LINE	Average
12	0.396	46.47	0.11	46.58	79.00	-32.42	LINE	QP

Remark : 1. All readings are Quasi-Peak and Average values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

Conducted Emission Test Data

Test Site : HA5 Test Date : 14-Oct-2022
 Series Number : MPA024-24 Temperature : 25°C
 Power Phase : NEUTRAL Humidity : 51%RH
 Test voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 2

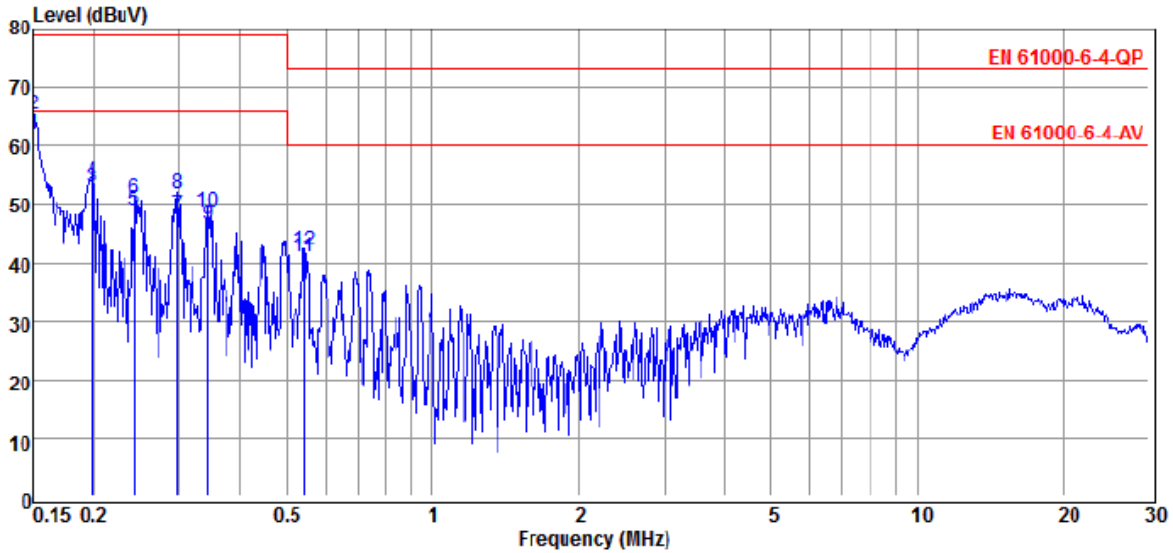

No.	Freq MHz	Reading dBµV	C.F dB	Result dBµV	Limit dBµV	Margin dB	Power Line	Remark
1	0.150	61.83	0.08	61.91	66.00	-4.09	NEUTRAL	Average
2	0.150	65.15	0.08	65.23	79.00	-13.77	NEUTRAL	QP
3	0.199	52.82	0.07	52.89	66.00	-13.11	NEUTRAL	Average
4	0.199	54.02	0.07	54.09	79.00	-24.91	NEUTRAL	QP
5	0.243	48.93	0.07	49.00	66.00	-17.00	NEUTRAL	Average
6	0.243	50.97	0.07	51.04	79.00	-27.96	NEUTRAL	QP
7	0.297	48.12	0.08	48.20	66.00	-17.80	NEUTRAL	Average
8	0.297	51.79	0.08	51.87	79.00	-27.13	NEUTRAL	QP
9	0.345	46.33	0.08	46.41	66.00	-19.59	NEUTRAL	Average
10	0.345	48.55	0.08	48.63	79.00	-30.37	NEUTRAL	QP
11	0.544	40.81	0.08	40.89	60.00	-19.11	NEUTRAL	Average
12	0.544	42.06	0.08	42.14	73.00	-30.86	NEUTRAL	QP

- Remark : 1. All readings are Quasi-Peak and Average values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

3 Radiated Emission Test

3.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

3.2 Test Configuration and Procedure

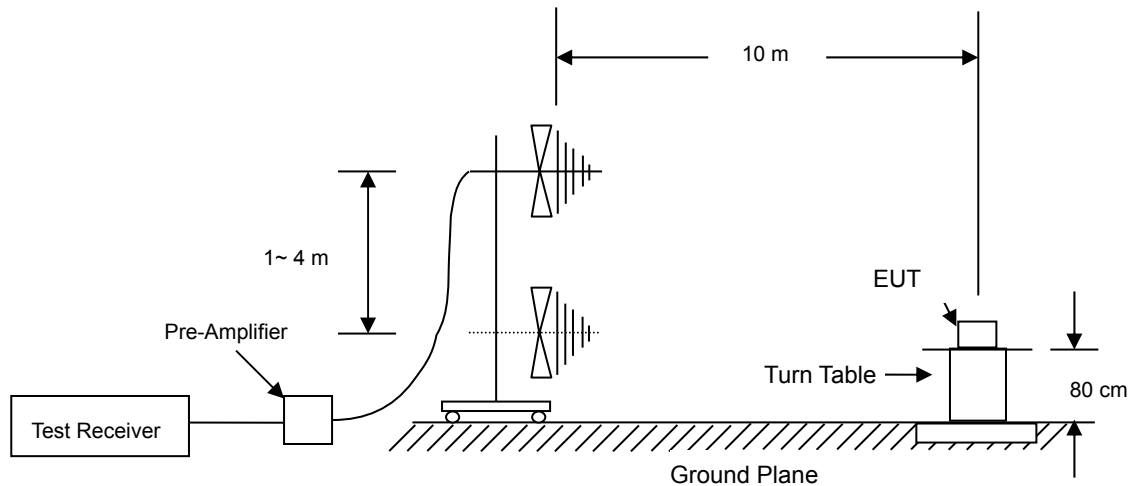


Table-top Equipment

- The EUT was placed on a non-conductive turntable which was 80 cm above the horizontal ground plane. The EUT was set 10 m away from the receiving antenna that was mounted on a non-conductive mast.
- Main cables draped to the ground plane and were routed to the mains power outlet. The mains power outlet was bonded to and did not protrude above the ground plane.
- The antenna was adjusted between 1 m and 4 m in height above the ground plane and the Antenna-to-EUT azimuth was also varied during the measurements to find the top 6 maximum meter readings within the frequency range limit as indicated in Sec 3.3.
- The radiated emissions were measured when the Antenna-to-EUT polarization was set horizontally and vertically.
- The values were recorded.

3.3 Radiated Limit

EN IEC 61000-6-4

Enclosure Port	
Frequency (MHz)	Quasi-Peak (dB μ V/m) at 10 m
30 to 230	40.0
230 to 1000	47.0


3.4 Test Result

PASS

The final test data are shown on the following page(s).

Radiated Emission Test Data

Test Site : HA2 10m Test Date : 12-Oct-2022
 Model Number : MPA048-24 Temperature : 25°C
 Polarization : Horizontal Humidity : 50%RH
 Test voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 1

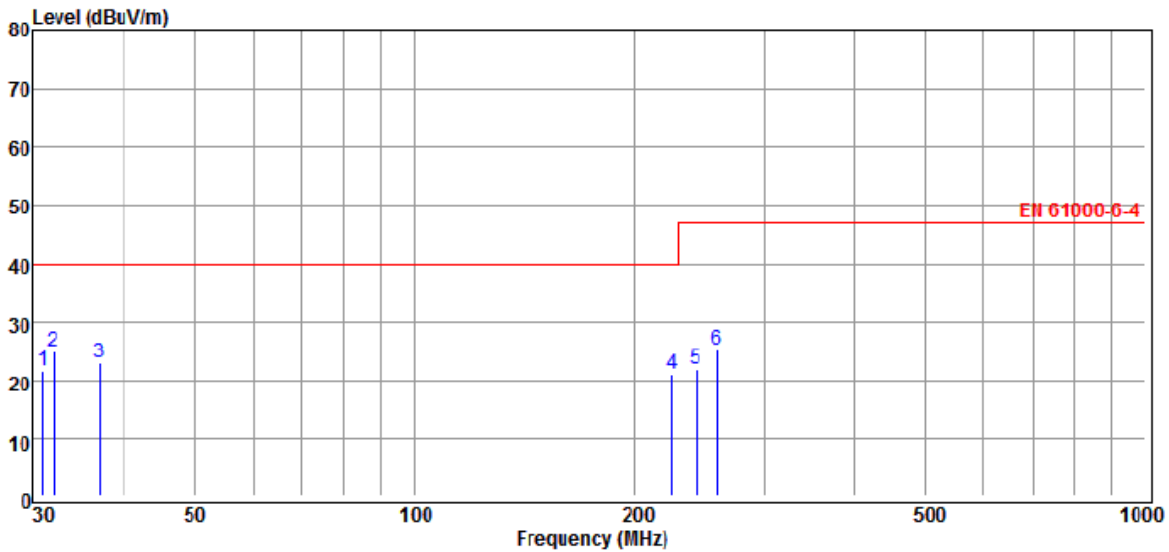


No.	Freq MHz	Reading dBμV	C.F dB/m	Result dBμV/m	Limit dBμV/m	Margin dB	Height cm	Angle deg	Antenna Pol.	Remark
1	30.999	26.04	-4.58	21.46	40.00	-18.54	379	151	HORIZONTAL	QP
2	31.996	30.19	-5.27	24.92	40.00	-15.08	375	156	HORIZONTAL	QP
3	37.051	31.05	-7.96	23.09	40.00	-16.91	377	242	HORIZONTAL	QP
4	225.406	33.96	-13.04	20.92	40.00	-19.08	335	243	HORIZONTAL	QP
5	242.555	33.04	-11.11	21.93	47.00	-25.07	336	200	HORIZONTAL	QP
6	258.687	33.82	-8.75	25.07	47.00	-21.93	331	34	HORIZONTAL	QP

Remark : 1. All readings are Quasi-Peak values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

Radiated Emission Test Data

Test Site : HA2 10m Test Date : 12-Oct-2022
 Model Number : MPA048-24 Temperature : 25°C
 Polarization : Vertical Humidity : 50%RH
 Test Voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 1

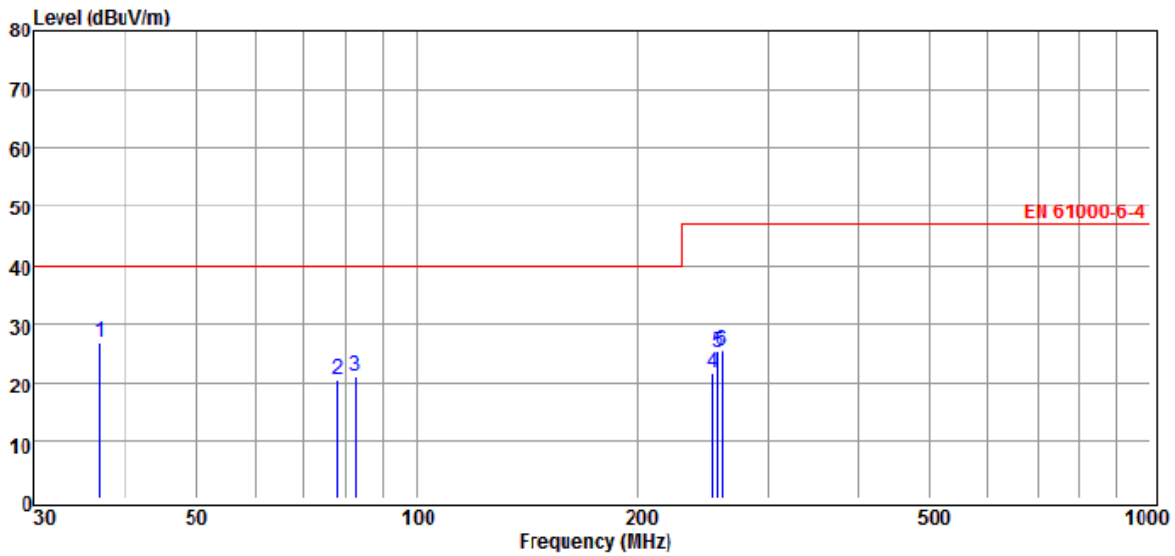


No.	Freq MHz	Reading dBµV	C.F dB/m	Result dBµV/m	Limit dBµV/m	Margin dB	Height cm	Angle deg	Antenna Pol.	Remark
1	36.995	34.79	-7.93	26.86	40.00	-13.14	101	172	VERTICAL	QP
2	78.002	36.83	-16.25	20.58	40.00	-19.42	104	106	VERTICAL	QP
3	82.232	36.49	-15.42	21.07	40.00	-18.93	103	295	VERTICAL	QP
4	253.111	31.35	-9.68	21.67	47.00	-25.33	111	189	VERTICAL	QP
5	256.692	34.24	-9.10	25.14	47.00	-21.86	118	206	VERTICAL	QP
6	259.992	33.83	-8.50	25.33	47.00	-21.67	120	154	VERTICAL	QP

Remark : 1. All readings are Quasi-Peak values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

Radiated Emission Test Data

Test Site : HA2 10m Test Date : 12-Oct-2022
 Series Number : MPA024-24 Temperature : 25°C
 Polarization : Horizontal Humidity : 50%RH
 Test voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 2

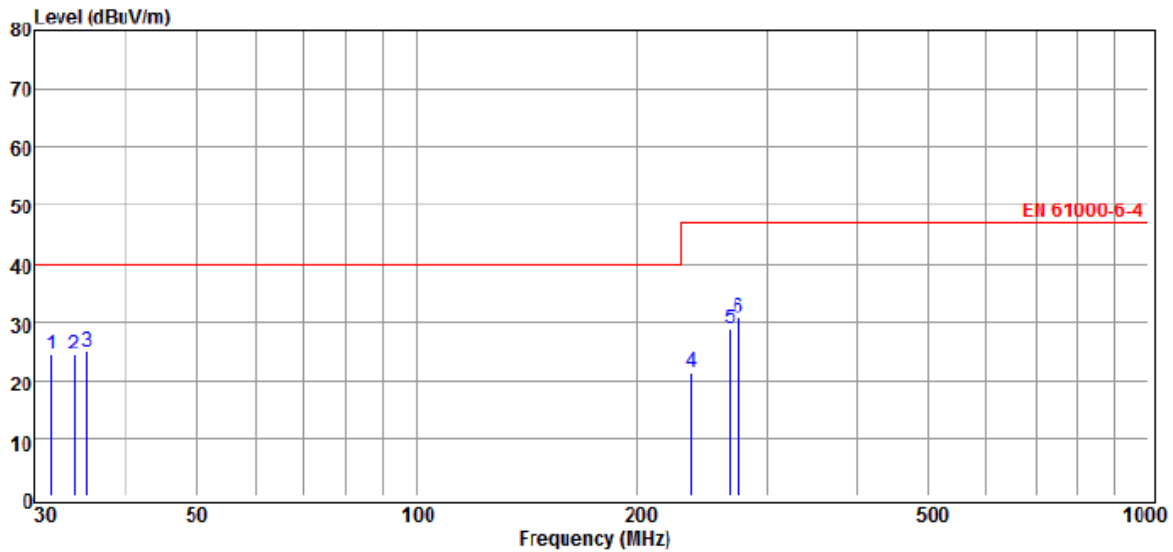


No.	Freq MHz	Reading dBμV	C.F dB/m	Result dBμV/m	Limit dBμV/m	Margin dB	Height cm	Angle deg	Antenna Pol.	Remark
1	31.623	29.35	-5.01	24.34	40.00	-15.66	376	223	HORIZONTAL	QP
2	33.999	30.69	-6.34	24.35	40.00	-15.65	379	353	HORIZONTAL	QP
3	35.317	32.14	-7.19	24.95	40.00	-15.05	380	98	HORIZONTAL	QP
4	237.195	33.09	-11.80	21.29	47.00	-25.71	329	196	HORIZONTAL	QP
5	267.741	37.95	-9.09	28.86	47.00	-18.14	335	66	HORIZONTAL	QP
6	274.995	40.53	-9.76	30.77	47.00	-16.23	337	164	HORIZONTAL	QP

- Remark :
1. All readings are Quasi-Peak values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

Radiated Emission Test Data

Test Site : HA2 10m Test Date : 12-Oct-2022
 Series Number : MPA024-24 Temperature : 25°C
 Polarization : Vertical Humidity : 50%RH
 Test Voltage : 230V/50Hz Test by : Luke Lu
 Description : Mode 2

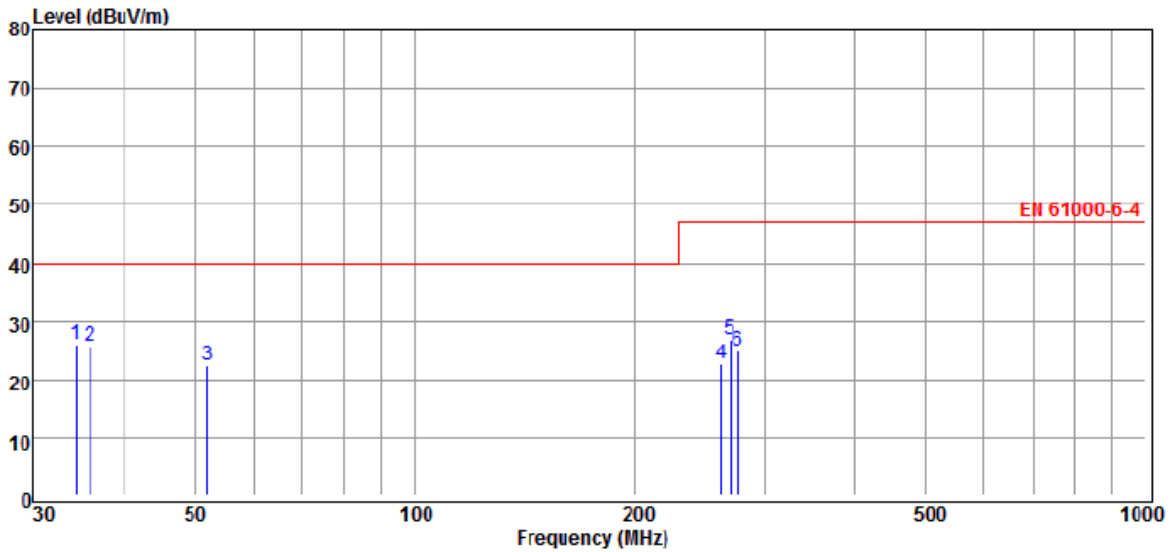

No.	Freq MHz	Reading dB μ V	C.F dB/m	Result dB μ V/m	Limit dB μ V/m	Margin dB	Height cm	Angle deg	Antenna Pol.	Remark
1	34.377	32.61	-6.53	26.08	40.00	-13.92	115	116	VERTICAL	QP
2	36.001	33.56	-7.93	25.63	40.00	-14.37	110	101	VERTICAL	QP
3	51.999	38.60	-16.13	22.47	40.00	-17.53	119	192	VERTICAL	QP
4	262.208	31.11	-8.51	22.60	47.00	-24.40	139	227	VERTICAL	QP
5	269.993	36.32	-9.55	26.77	47.00	-20.23	131	251	VERTICAL	QP
6	276.665	34.76	-9.80	24.96	47.00	-22.04	136	48	VERTICAL	QP


Remark : 1. All readings are Quasi-Peak values.
 2. Result = Reading + C.F..
 3. Margin = Result – Limit.

4 Harmonic Current Emission Measurement

4.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

4.2 Test Configuration and Procedure

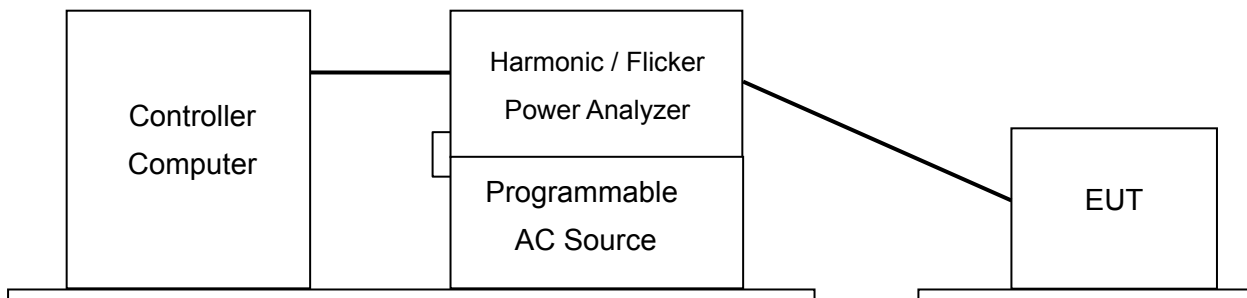

- The EUT was set in series with the Power Analyzer through an Impedance Network for the measurement of harmonic currents.
- The supply voltage and frequency setting on the Programmable AC Source was programmed as the rated voltage and frequency of the EUT.
- Classify the EUT class in accordance with the IEC 61000-3-2 for the purpose of harmonic current limitation. The measurement was automatically performed by test software. The test result was collected and analyzed by the computer.

4.3 EUT Operation Condition

Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA3	12-Oct-2022	24°C	52%RH	1004mbar

4.4 Test Limit

Class A Equipment

Harmonic Order (n)	Maximum permissible harmonic current (A)
Odd harmonics	
3	2.30
5	1.14
7	0.77
9	0.40
11	0.33
13	0.21
$15 \leq n \leq 39$	$0.15 * 15 / n$
Even harmonics	
2	1.08
4	0.43
6	0.30
$8 \leq n \leq 40$	$0.23 * 8 / n$


4.5 Test Result

PASS


The measured result is shown on the following page(s).

Test Result: Pass Source qualification: Normal

Current & voltage waveforms

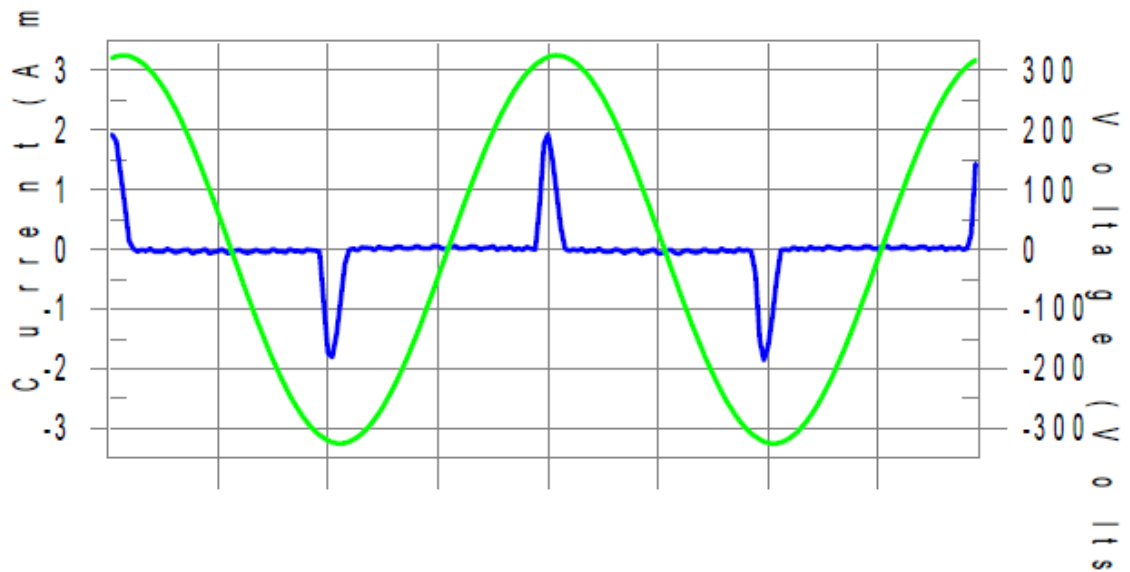

Harmonics and Class A limit line European Limits

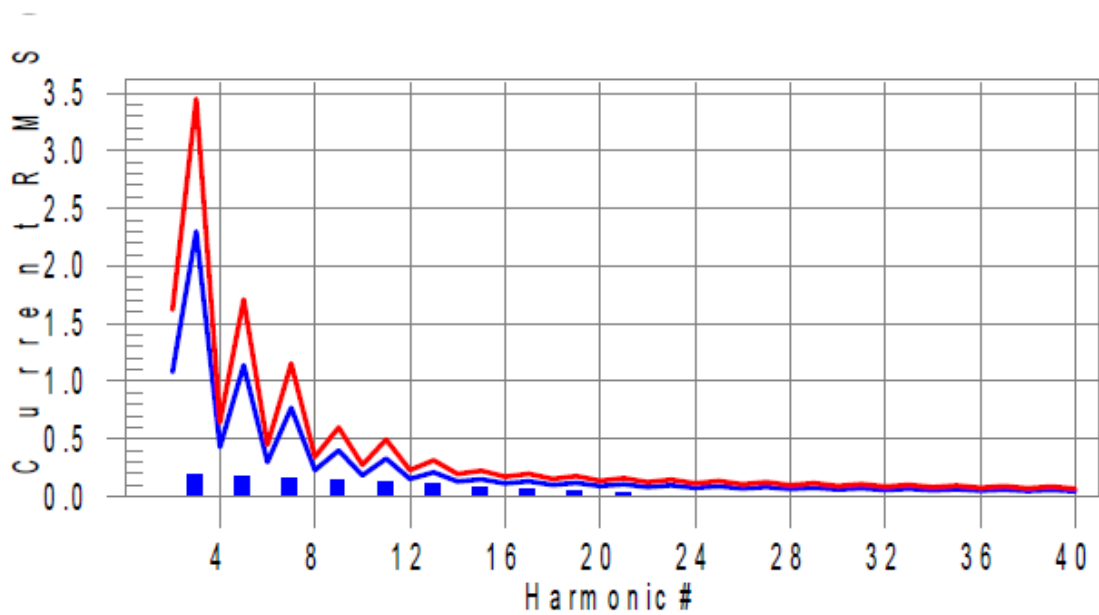

Test result: Pass Worst harmonics H15-37.8% of 150% limit, H15-54.9% of 100% limit

Test Result: Pass Source qualification: Normal
 THC(A): 0.400 I-THD(%): 199.5 POHC(A): 0.054 POHC Limit(A): 0.251

Highest parameter values during test:

V_RMS (Volts): 230.06 Frequency(Hz): 50.00
 I_Peak (Amps): 1.987 I_RMS (Amps): 0.452
 I_Fund (Amps): 0.201 Crest Factor: 4.416
 Power (Watts): 45.0 Power Factor: 0.441

Harm#	Harms(avg)	100%Limit	%of Limit	Harms(max)	150%Limit	%of Limit	Status
2	0.003	1.080	N/A	0.004	1.620	N/A	Pass
3	0.191	2.300	8.3	0.191	3.450	5.5	Pass
4	0.003	0.430	N/A	0.004	0.645	N/A	Pass
5	0.180	1.140	15.8	0.181	1.710	10.6	Pass
6	0.003	0.300	N/A	0.004	0.450	N/A	Pass
7	0.165	0.770	21.5	0.166	1.155	14.4	Pass
8	0.003	0.230	N/A	0.004	0.345	N/A	Pass
9	0.147	0.400	36.7	0.148	0.600	24.7	Pass
10	0.003	0.184	N/A	0.003	0.276	N/A	Pass
11	0.126	0.330	38.2	0.128	0.495	25.9	Pass
12	0.002	0.153	N/A	0.003	0.230	N/A	Pass
13	0.104	0.210	49.6	0.107	0.315	33.8	Pass
14	0.002	0.131	N/A	0.003	0.197	N/A	Pass
15	0.082	0.150	54.9	0.085	0.225	37.8	Pass
16	0.002	0.115	N/A	0.002	0.173	N/A	Pass
17	0.062	0.132	46.8	0.065	0.198	32.7	Pass
18	0.002	0.102	N/A	0.002	0.153	N/A	Pass
19	0.044	0.118	36.8	0.047	0.178	26.3	Pass
20	0.002	0.092	N/A	0.002	0.138	N/A	Pass
21	0.029	0.107	27.2	0.032	0.161	19.8	Pass
22	0.001	0.084	N/A	0.002	0.125	N/A	Pass
23	0.020	0.098	20.3	0.022	0.147	14.8	Pass
24	0.001	0.077	N/A	0.002	0.115	N/A	Pass
25	0.017	0.090	18.4	0.017	0.135	12.7	Pass
26	0.001	0.071	N/A	0.002	0.107	N/A	Pass
27	0.017	0.083	20.5	0.018	0.125	14.1	Pass
28	0.001	0.066	N/A	0.002	0.099	N/A	Pass
29	0.018	0.078	22.9	0.018	0.116	15.8	Pass
30	0.001	0.061	N/A	0.001	0.092	N/A	Pass
31	0.017	0.073	23.7	0.018	0.109	16.8	Pass
32	0.001	0.058	N/A	0.002	0.086	N/A	Pass
33	0.015	0.068	22.4	0.017	0.102	16.4	Pass
34	0.001	0.054	N/A	0.001	0.081	N/A	Pass
35	0.012	0.064	19.2	0.014	0.096	14.5	Pass
36	0.001	0.051	N/A	0.001	0.077	N/A	Pass
37	0.009	0.061	14.7	0.011	0.091	11.6	Pass
38	0.001	0.048	N/A	0.001	0.073	N/A	Pass
39	0.006	0.058	9.9	0.007	0.087	8.2	Pass
40	0.001	0.046	N/A	0.001	0.069	N/A	Pass


Note: The EUT power level is below 75watts therefore has no defined limits.

5 Voltage Fluctuations and Flicker Measurement

5.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

5.2 Test Configuration and Procedure

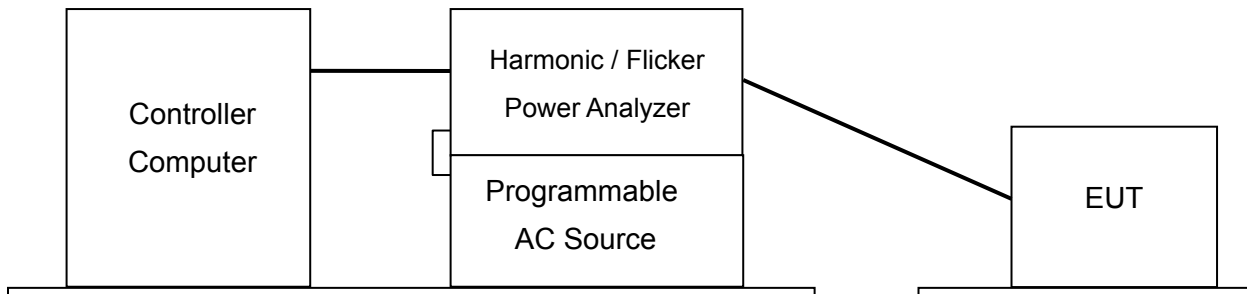

- The EUT was set in series with the Power Analyzer through an Impedance Network for the measurement of Flicker Voltage.
- The supply voltage and frequency setting on the Programmable AC Source was programmed as the rated voltage and frequency of the EUT.
- The measurement was automatically performed by test software. The test result was collected and analyzed by the computer.

5.3 EUT Operation Condition

Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA3	12-Oct-2022	24°C	52%RH	1004mbar

5.4 Test Limit

Test Item	Limit	Remark
P _{st}	1.0	P _{st} means short-term flicker indicator. T _p =10 min
P _{lt}	0.65	P _{lt} means long-term flicker indicator. T _p =2 hrs
dt (%)	3.3	For more than 500ms
d _{max} (%)	4	d _{max} means relative maximum voltage change.
d _c (%)	3.3	d _c means relative steady-state voltage change.

5.5 Test Result

PASS


The measured result is shown on the following page(s).

Test Result: Pass


Status: Test Completed

Pst_i and limit line

European Limits

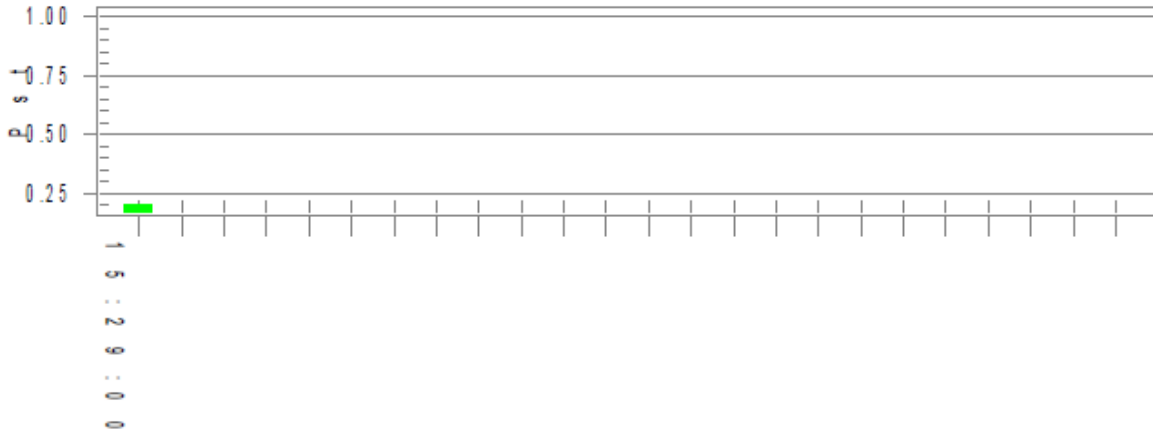

Plt and limit line

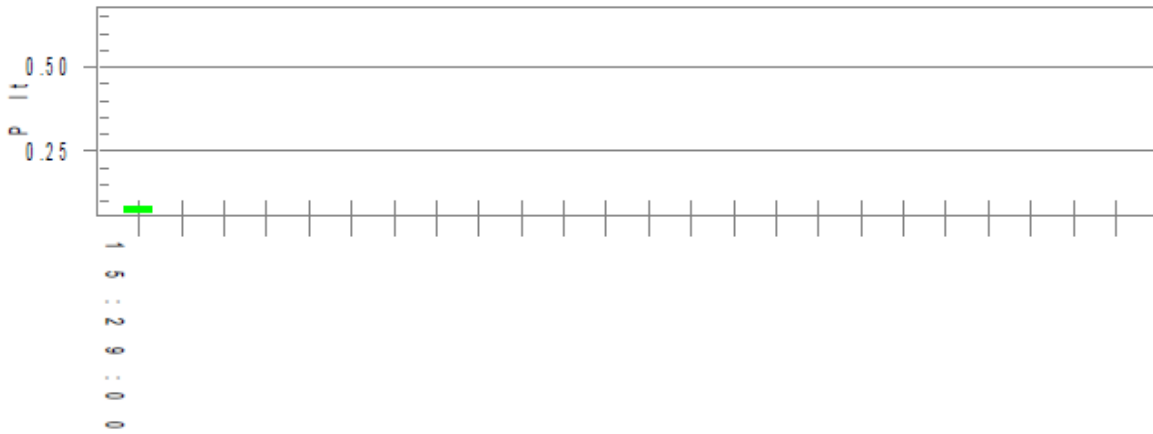

Parameter values recorded during the test:

Vrms at the end of test (Volt):	229.96		
Highest dt (%):		Test limit (%):	
T-max (mS):	0	Test limit (mS):	500.0 Pass
Highest dc (%):	0.00	Test limit (%):	3.30 Pass
Highest dmax (%):	0.00	Test limit (%):	4.00 Pass
Highest Pst (10 min. period):	0.200	Test limit:	1.000 Pass
Highest Plt (2 hr. period):	0.088	Test limit:	0.650 Pass

6 Electrostatic Discharge Immunity Test

6.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

6.2 Test Configuration and Procedure

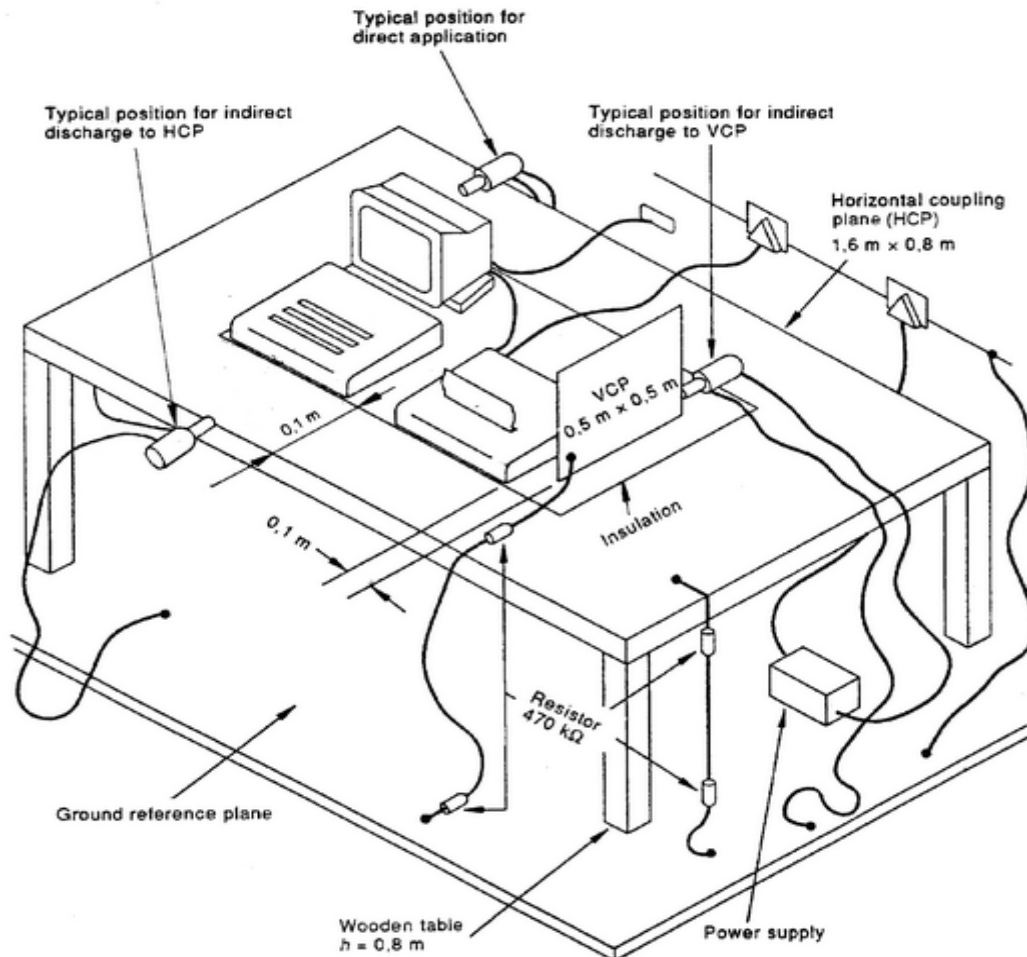


Table-top Equipment

- The EUT was located on a 0.8 m high wooden table standing on the ground reference plane with a 1.6 * 0.8 m horizontal coupling plane on the top. The EUT and cables was isolated from the coupling plane by an insulating support 0.5 mm thick.
- In Contact Discharge, the EUT was exposed to minimum 20 discharges each at negative and positive polarity on the selected test points (the selected test points were marked with red labels on the EUT)
- In Air Discharge, the EUT exposed to minimum of 20 discharges each at negative and positive polarity on the selected test points as well.
- The result was observed and analyzed.

6.3 Test Result

6.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA6	14-Oct-2022	24°C	55%RH	1002mbar

6.3.2 Observation of Direct Discharge

Test Points: 1. Surface of Case 2. Junction of Case. 3. LED Indicator.

Type of Discharge	Test Specifications				Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Test Level	Polarity	Test Point	Number of Discharge			
Air Discharge	2,4,8 (kV)	±	1~3	10/ per point	B	A	Pass ¹
Contact Discharge	4 (kV)	±	-	10/ per point	B	-	N/A
Remarks	1. No temporary degradation or loss of function has been observed throughout the entire time interval of air discharge.						
Note	The selected points were marked with labels on the EUT.						

The Performance Requirement Class Criterion is defined in Sec. 1.11.

6.3.3 Observation of Indirect Discharge

Test Points: 1. Front Side. 2. Rear Side. 3. Left Side. 4. Right Side.

Type of Discharge	Test Specifications				Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Test Level	Polarity	Test Point	Number of Discharge			
HCP Application	4 (kV)	±	1~4	10/ per point	B	A	Pass ¹
VCP Application	4 (kV)	±	1~4	10/ per point	B	A	Pass ²
Remarks	1. No temporary degradation or loss of function has been observed throughout the entire time interval of HCP application. 2. No temporary degradation or loss of function has been observed throughout the entire time interval of VCP application.						
Note	The selected points were marked with labels on the EUT.						

The Performance Requirement Class Criterion is defined in Sec. 1.11.

PASS

The test result shows that the EUT is in compliance with the test performance criteria specified in EN IEC 61000-6-2.

7 Radio-frequency, Electromagnetic Field Immunity Test

7.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

7.2 Test Configuration and Procedure

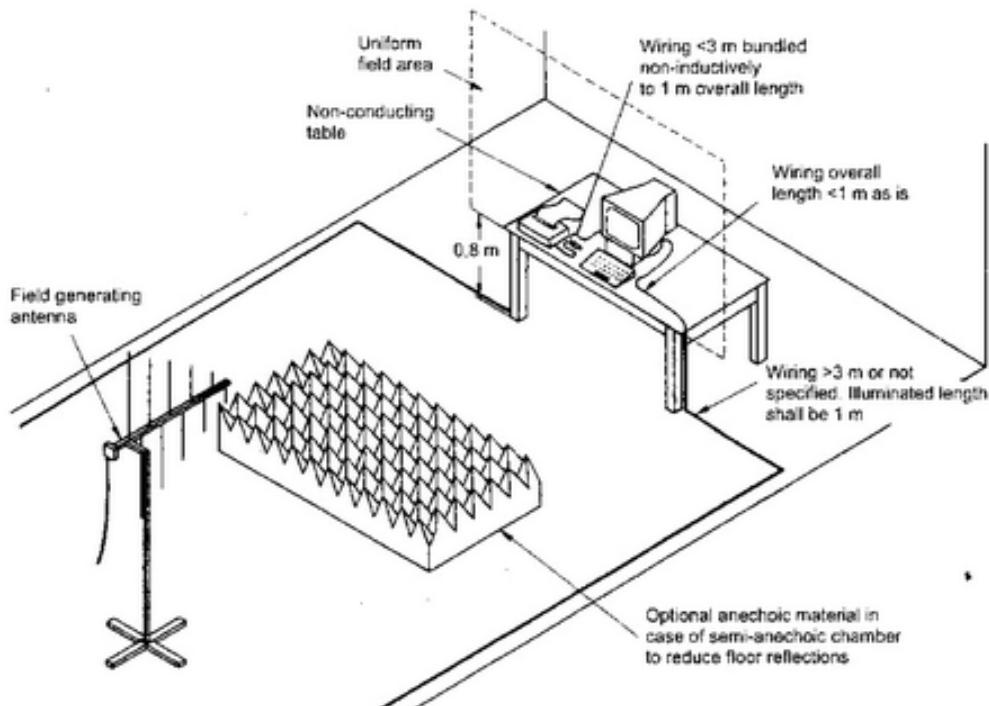


Table-top Equipment

- The field calibration was executed to create a uniform field area (UFA), 3 m away from the antenna, to ensure the validity of the test results.
- The EUT was placed on a non-conductive table 0.8 m high in the UFA.
- The EUT was then connected to power and signal wires according to relevant installation instruction.
- The EUT was positioned so that the four sides of the EUT were exposed to the electromagnetic field in sequence. In each position, the performance of the EUT was investigated and monitored by a CCD camera..

7.3 Test Result

7.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA3	12-Oct-2022	25°C	54%RH	1004mbar

7.3.2 Observation of Direct Discharge

Type of Modulation	Test Specification				Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Field Strength	Frequency Range	Modulated	Polarity			
Amplitude Modulation	10V/m	80 to 1000MHz	1kHz, 80% AM, Sine wave	V&H	A	A	Pass ¹
Amplitude Modulation	3V/m	1.4 to 3.0 GHz	1kHz, 80% AM, Sine wave	V&H	A	A	Pass ¹
Remark:	1. No temporary degradation or less of function has been observed through out the entire time interval of the test.						
Note	The applied 0°, 90°, 180°, 270° relative to the position to the equipment under test.						

The Performance Requirement Class Criterion is defined in Sec. 1.11.

7.3.3 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
Refer to Clause 1.2	13-Oct-2022	25°C	55%RH	1005mbar

7.3.4 Observation of Test

Type of Modulation	Test Specification				Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Field Strength	Frequency Range	Modulated	Polarity			
Amplitude Modulation	3V/m	3.0 to 6.0 GHz	1kHz, 80% AM, Sine wave	V&H	A	A	Pass ^{1,2}
Remark:	1. No temporary degradation or less of function has been observed through out the entire time interval of the test. 2. The test item was performed at an ISO 17025 accredited facility where this test item is covered under the scope of the facility's ISO 17025 accreditation. Detail of the facility is recorded at clause 1.2 of this report.						

Note	The applied 0°, 90°, 180°, 270° relative to the position to the equipment under test.
------	---

The Performance Requirement Class Criterion is defined in Sec. 1.11.

PASS

The test result shows that the EUT compliant with the test requirement specified in EN IEC 61000-6-2.

8 Electrical Fast Transient Test

8.1 Test Instrument

Refer to Sec. 1.3 Test Instruments.

8.2 Test Configuration and Procedure

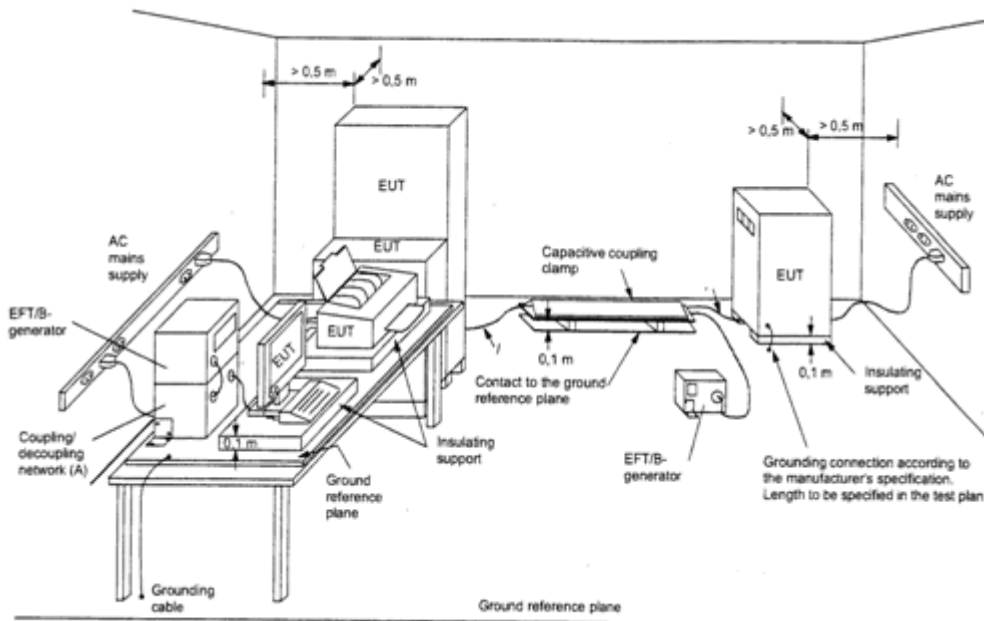


Table-top Equipment

- The EUT was placed on a table of 0.8 m height above the 1 * 1 m metallic ground reference plane, which projected beyond the EUT by at least 0.1 m on all sides.
- The ground plane was connected to the protective earth.
- The distance between the EUT and all other conductive structures, except the ground plane beneath the EUT was more than 0.5 m.
- The length of the signal and power lines between the coupling device and the EUT was 0.5 m.
- All cables to the EUT were placed on the insulation support 0.1 m above the ground reference plane.
- The EUT was connected to the power mains through a coupling device that directly coupled the EFT interference signal. Each of the Line, Neutral and Protective Earth conductors was injected with burst for 1 minute. The test time was broken down into six 10 s bursts separated by a 10 s pause for avoiding synchronization. Both voltage polarities were applied for each test level.
- Operating condition was shown on the monitor and observed.

8.3 Test Result

8.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA6	14-Oct-2022	24°C	51%RH	1002mbar

8.3.2 Observation of AC Power Port

Coupling Selection	Test Specifications				Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Voltage (kV)	Test Duration (Sec)	Repetition frequency (kHz)	Tr/ Th (ns)			
L	±2	60	5	5/50	B	A	Pass ¹
N	±2	60	5	5/50	B	A	Pass ¹
PE	±2	60	5	5/50	B	A	Pass ¹
L + N	±2	60	5	5/50	B	A	Pass ¹
L + PE	±2	60	5	5/50	B	A	Pass ¹
N + PE	±2	60	5	5/50	B	A	Pass ¹
L + N +PE	±2	60	5	5/50	B	A	Pass ¹
Remark	1. No temporary degradation or loss of function has been observed throughout the entire test.						

The Performance Requirement Class Criterion is defined in Sec. 1.11.

8.3.3 Observation of signal ports (Applicable only to cable length >3m)

There was no signal cable longer than 3 meter; therefore, no test has been required.

PASS

The test result shows that the EUT is in compliance with the test performance criteria specified in EN IEC 61000-6-2.

9 Surge Immunity Test

9.1 Test Instrument

Refer to Sec. 1.3 Test Instruments.

9.2 Test Configuration and Procedure

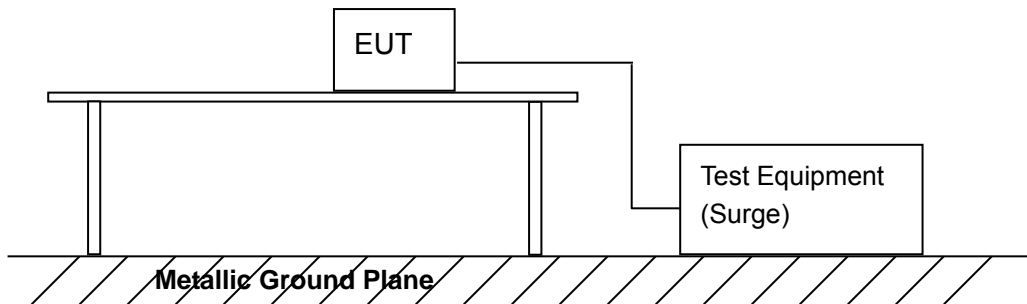


Table-top Equipment

- The EUT was placed on a table of 0.8 m height above the 1 * 1 m metallic ground reference plane, which projected beyond the EUT by at least 0.1 m on all sides.
- The ground plane was connected to the protective earth.
- The length of power cord between the coupling device and the EUT is less than 2 m (provided by the manufacturer).
- The EUT was connected to the power mains through a coupling device that directly couples the Surge interference signal. The surge noise was applied synchronized to the voltage phase at the zero crossing and the peak value of the AC voltage wave (positive and negative).
- The surges were applied line to line and line(s) to earth. When testing line to earth the test voltage was applied successively between each of the lines and earth. Steps up to the test level specified increased the test voltage. All lower levels including the selected test level were tested. The polarity of each surge level included positive and negative test pulses.
- Operating condition was shown on the monitor and observed.

9.3 Test Result

9.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA6	14-Oct-2022	24°C	53%RH	1002mbar

9.3.2 Observation of AC Power Port

Coupling Selection	Test Specifications			Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Voltage (kV)	Min. of Surge at Each Polarity	Repetition Rate (per min)			
L ► N	±0.5,1	5	1	B	A	Pass ¹
L ► PE	±0.5,1,2	5	1	B	A	Pass ¹
N ► PE	±0.5,1,2	5	1	B	A	Pass ¹
Remark	1. No temporary degradation or loss of function has been observed throughout the entire test.					

The Performance Requirement Class Criterion is defined in Sec. 1.11.

9.3.3 Observation of other supply/ signal lines: (Applicable only to ports which according to the manufacturer's specification may exceed 30m)

N/A

PASS


The test result shows that the EUT is in compliance with the test performance criteria specified in EN IEC 61000-6-2.

10 Radio-frequency, Conducted Disturbances Immunity Test

10.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

10.2 Test Configuration and Procedure

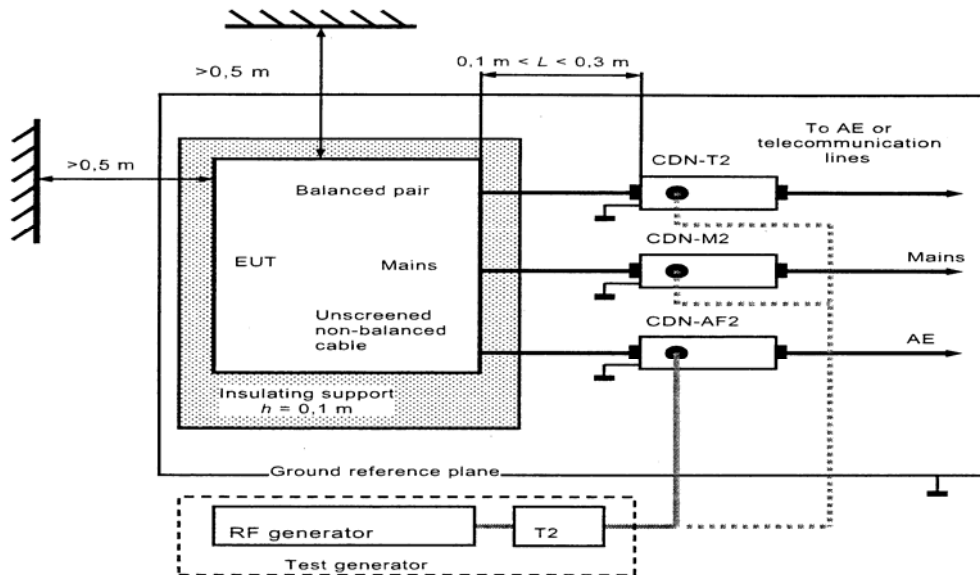

- The EUT was placed on an insulating support of 0.1 m height above a ground reference plane. All cables exiting the EUT was supported at a height of 30 mm above the ground reference plane.
- The EUT was connected to the power mains through a Coupling and Decoupling Networks (CDN).
- The CDN was located 0.3 m from the EUT as indicated in the diagram above.
- The test was performed with the test generator connected to each of the CDN in turn while the other non-excited RF input ports of the coupling devices were terminated by a 50 Ω terminator.
- The conducted disturbance was applied on the EUT from 150 kHz to 80 MHz using the signal levels established during the setting process. .
- Operating condition was shown on the monitor and observed.

10.3 Test Result

10.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA6	14-Oct-2022	24°C	55%RH	1002mbar

10.3.2 Observation of AC Power Port

Type of Modulation	Test Specifications			Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Voltage Level (emf) U_0	Frequency Range	Modulated			
Amplitude Modulation	10V/ 140dB μ V	0.15 to 80MHz	1kHz, 80% AM, Sine wave	A	A	Pass ¹
Remark	1. No temporary degradation or loss of function has been observed throughout the entire test.					

The Performance Requirement Class Criterion is defined in Sec. 1.11.

10.3.3 There was no Signal ports cable longer than 3 m, therefore, no test has been required.

PASS

The test result shows that the EUT is in compliance with the test performance criteria specified in EN IEC 61000-6-2.

11 Power Frequency Magnetic Field Immunity Test

11.1 Test Instruments

Refer to Sec. 1.3 Test Instruments.

11.2 Test Configuration and Procedure

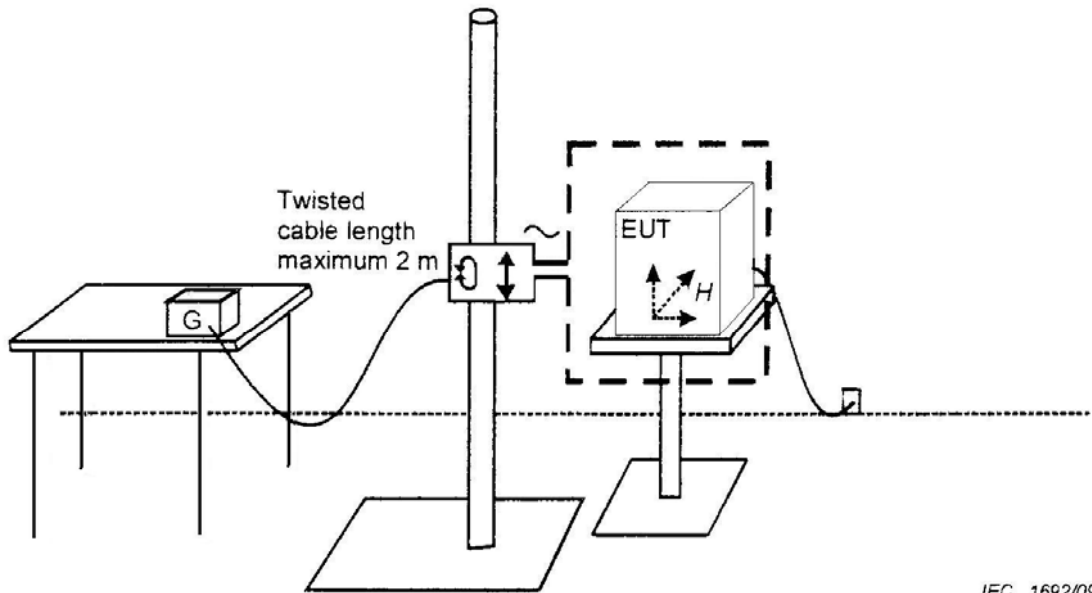


Table-top Equipment

- The EUT was placed on a non-magnetic metal ground plane of 0.25 mm thickness with the interposition of a 0.1 m thickness insulating support. The ground plane was connected to the protected earth.
- The EUT was placed at the center of the 1 * 1 m induction coil with the test generator placed within 3 m distance.
- The test was operated by moving and shifting the induction coil to expose to the test field.
- The operation condition was observed and analyzed.
- The induction coil was then rotated by 90° to expose the EUT to the test field with different orientations and the same procedure.

11.3 Test Result

11.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA3	12-Oct-2022	25°C	52%RH	1004mbar

11.3.2 Observation of Test

Level (A/m)	Frequency (Hz)	Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
30	50	A	A	Pass ¹
Remark	1. No temporary degradation or loss of function has been observed throughout the entire test.			

The Performance Requirement Class Criterion is defined in Sec. 1.11.

PASS


The test result shows that the EUT is in compliance with the test performance criteria specified in EN IEC 61000-6-2.

12 Voltage Dips, Short Interruptions Immunity Test

12.1 Test Instrument

Refer to Sec. 1.3 Test Instruments.

12.2 Test Configuration and Procedure

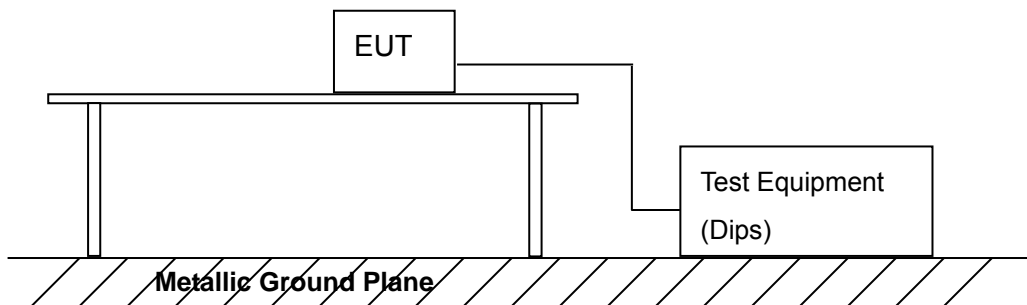

- The EUT was tested with (I) 0% voltage dip of supplied voltage with a duration of 20 ms (II) 40% voltage dip of supplied voltage with duration 200 ms (III) 70% voltage dip of supplied voltage with duration 500 ms (IV) A 0% voltage interruption of supplied voltage with duration of 5000 ms,
- For each selected combination of test level and duration with a sequence of three dips / interruptions with intervals of 10 s.
- For Voltage Dips, changes in supply voltage occurred at zero crossings of the voltage.
- For Short Interruptions, changes in supply voltage also occurred at zero crossings of the voltage.

12.3 Test Result

12.3.1 Environment Condition

Test Site	Test Date	Temperature	Humidity	Atmospheric Pressure
HA6	14-Oct-2022	25°C	54%RH	1002mbar

12.3.2 Observation of Power Supply Port

Voltage Dips

Voltage Residual (%)	Test Specifications			Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Duration Periods	No. of Reductions	Interval between Each Duration (sec.)			
0	1	3	≥ 10	B	A	Pass ¹
40	10	3	≥ 10	C	A	Pass ¹
70	25	3	≥ 10	C	A	Pass ¹
Remarks	1. No temporary degradation or loss of function has been observed throughout the entire test.					

The Performance Requirement Class Criterion is defined in Sec. 1.11.

Voltage Interruptions

Voltage Residual (%)	Test Specifications			Performance Required by EN IEC 61000-6-2	Observed Result	Verdict
	Duration Periods	No. of Reductions	Interval between Each Duration (sec.)			
0	250	3	≥ 10	C	B	Pass ¹
Remark	1. When testing Voltage Interruptions with 0% of normal power supply, the EUT shut down automatically. After testing, the EUT recovered its function.					

The Performance Requirement Class Criterion is defined in Sec. 1.11.

PASS

The test result shows that the EUT is in compliance with the test performance criteria specified in EN IEC 61000-6-2.

13 Photographs of Test

13.1 Power Line Conducted Test (Model No.: MPA048-24)



Front View



Rear View

13.2 Power Line Conducted Test (Series No.: MPA024-24)



Front View



Rear View

13.3 Radiated Emission Test (Model No.: MPA048-24)



Front View



Rear View

13.4 Radiated Emission Test (Series No.: MPA024-24)




Front View



Rear View

13.5 Harmonic Current & Voltage Fluctuations and Flicker Measurement

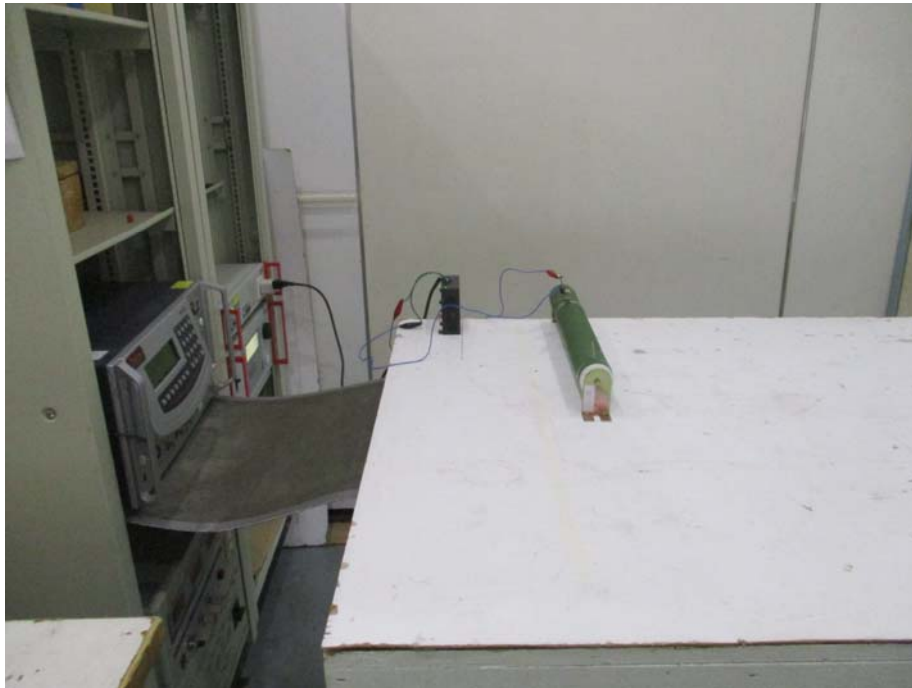

13.6 Electrostatic Discharge Immunity Test



13.7 Radio-frequency, Electromagnetic Field Immunity Test




13.8 Electrical Fast Transient / Burst Immunity Test



13.9 Surge Immunity Test



13.10 Radio-frequency, Conducted Disturbances Immunity Test

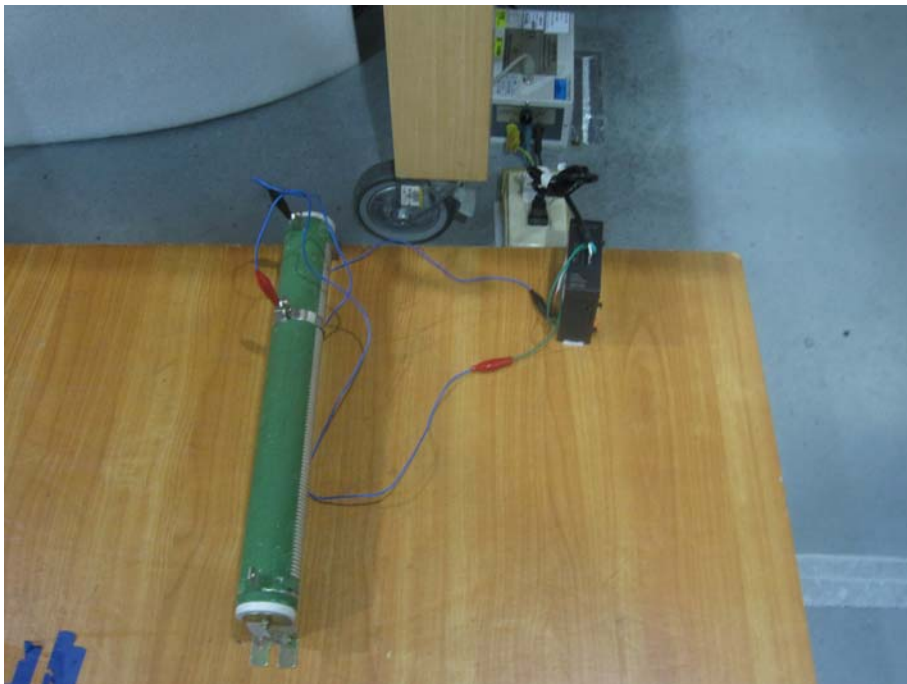

13.11 Power Frequency Magnetic Field Immunity Test



13.12 Voltage Dips, Short Interruptions Immunity Test



14 Photographs of EUT



Front View of the EUT




Rear View of the EUT



Inside View of the EUT



Front View of the PCB

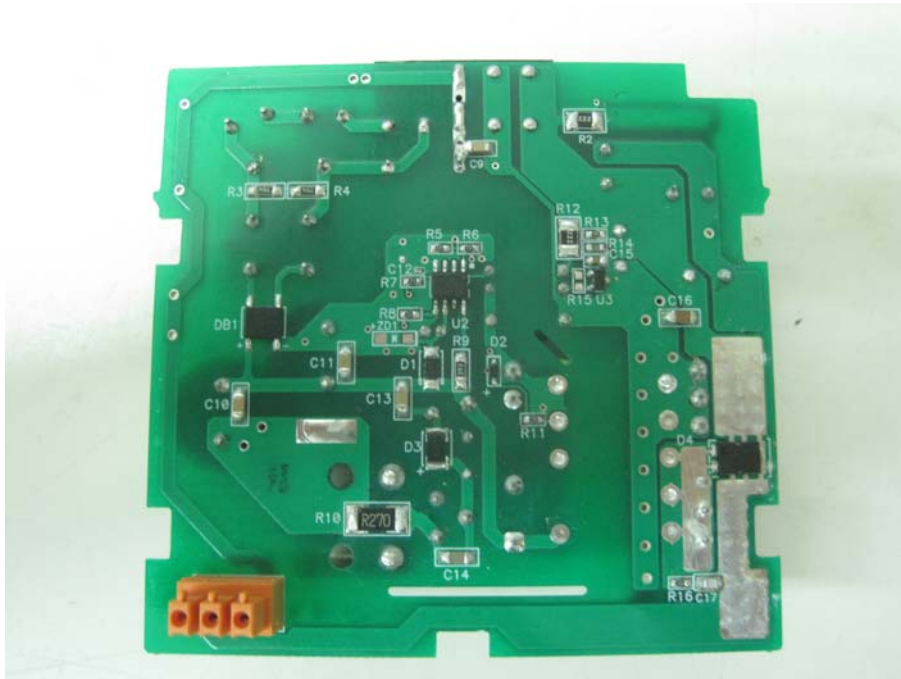

Rear View of the PCB



View of the EUT Label

15 Photographs of Series



Front View of the Series




Rear View of the Series



Inside View of the Series



Front View of the PCB

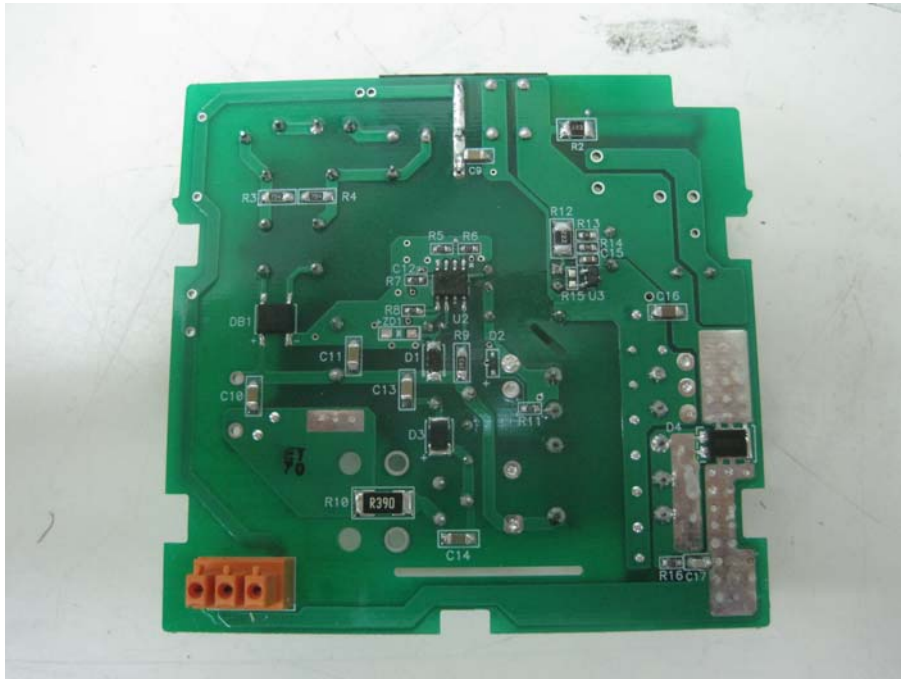

Rear View of the PCB



View of the Series Label

16 Photographs of ESD Test Points



View of ESD Test Points



View of ESD Test Points



View of ESD Test Points



View of ESD Test Points



View of ESD Test Points